

**HOONETE VENTILATSIOON. VENTILATSIOONI
KESKSEADMED. KOMPONENTIDE JA SEKTSIOONIDE
VALIK NING TOIMIMINE KESKSEADMES**

**Ventilation for buildings - Air handling units - Rating
and performance for units, components and sections
CONSOLIDATED TEXT**

EESTI STANDARDI EESSÕNA**NATIONAL FOREWORD**

See Eesti standard EVS-EN 13053:2006+A1:2011 sisaldab Euroopa standardi EN 13053:2006+A1:2011 ingliskeelset teksti.	This Estonian standard EVS-EN 13053:2006+A1:2011 consists of the English text of the European standard EN 13053:2006+A1:2011.
Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas.	This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation.
Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 06.07.2011.	Date of Availability of the European standard is 06.07.2011.
Standard on kättesaadav Eesti Standardikeskusest.	The standard is available from the Estonian Centre for Standardisation.

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile standardiosakond@evs.ee.

ICS 91.140.30

Standardite reprodutseerimise ja levitamise õigus kuulub Eesti Standardikeskusele

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonsesse süsteemi või edastamine ükskõik millises vormis või millisel teel ilma Eesti Standardikeskuse kirjaliku loata on keelatud.

Kui Teil on küsimusi standardite autorikaitse kohta, võtke palun ühendust Eesti Standardikeskusega: Aru 10, 10317 Tallinn, Eesti; koduleht www.evs.ee; telefon 605 5050; e-post info@evs.ee

The right to reproduce and distribute standards belongs to the Estonian Centre for Standardisation

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without a written permission from the Estonian Centre for Standardisation.

If you have any questions about copyright, please contact Estonian Centre for Standardisation:

Aru 10, 10317 Tallinn, Estonia; homepage www.evs.ee; phone +372 605 5050; e-mail info@evs.ee

English Version

Ventilation for buildings - Air handling units - Rating and performance for units, components and sections

Ventilation des bâtiments - Caissons de traitement d'air -
Classification et performance des unités, composants et
sections

Lüftung von Gebäuden - Zentrale raumluftechnische
Geräte - Leistungskenndaten für Geräte, Komponenten und
Baueinheiten

This European Standard was approved by CEN on 26 June 2006 and includes Amendment 1 approved by CEN on 19 May 2011.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword	4
1 Scope	6
2 Normative references	6
3 Terms and definitions	8
4 Symbols and abbreviations	10
5 Ratings and performance of the entire air handling unit	13
5.1 General	13
5.2 Testing of aerodynamic performance	13
5.2.1 Characteristics and quantities	13
5.2.2 Test method	15
5.2.3 Measurement procedure	15
5.2.4 Evaluation of results	17
5.3 Testing of acoustic performance	17
5.3.1 General	17
5.3.2 Specific requirements concerning the set-up of acoustic tests	18
5.4 Tolerances	22
5.5 Test report	23
6 Ratings and performance of the entire air handling unit	26
6.1 General	26
6.2 Casing	26
6.3 Fan section	28
6.3.1 General	28
6.3.2 A_1 Power input of fans A_1	29
6.4 Coils	30
6.4.1 General	30
6.4.2 Testing	30
6.4.3 Construction	30
6.4.4 Cooler/Droplet Eliminator	30
6.5 Heat recovery sections	31
6.5.1 General	31
6.5.2 Classifications and requirements	31
6.5.3 Testing	34
6.6 Damper sections	34
6.6.1 General	34
6.6.2 Requirements and testing	34
6.7 Mixing sections	34
6.7.1 General	34
6.7.2 Categories and characteristics	35
6.7.3 Requirements	35
6.7.4 Measurements	37
6.7.5 Field testing of mixing efficiency	38
6.8 Humidifiers	38
6.8.1 General	38
6.8.2 Categories	39
6.8.3 Requirements	39
6.9 Filter sections	41
6.9.1 General requirements	41
6.9.2 Filters installed in air handling units	42
6.10 Passive sound attenuation sections	43
7 Extended hygiene requirements for special applications	43

7.1	General	43
7.2	Accessibility	43
7.3	Smoothness	43
7.4	Inspection windows and lights	44
7.5	Drainage/prevention of condensation, humidifiers	44
7.6	Air leakage	44
8	Instructions for installation, operation and maintenance	44
8.1	Installation	44
8.2	Operation and maintenance	44
8.3	Documentation and labelling	45
Annex A (informative) Air handling units - Heat recovery – Defrosting - Requirements and testing		46
A.1	General	46
A.2	Defrosting	46
A.2.1	Defrosting heat factor	46
A.2.2	Non-cyclic defrosting	46
A.2.3	Cyclic defrosting	46
A.3	Testing	47
A.3.1	Test rig	47
A.3.2	Duty points	48
A.3.3	Test procedures	48
A.3.4	Testing of defrosting heat factor	48
A.3.5	Total measuring time	48
A.4	Test report	49
A.4.1	The heat recovery device	49
A.4.2	The defrosting heat factor	49
Annex B (informative)  Air handling units – Heat recovery – Characteristics 		50
B.1	Efficiency of the heat recovery	50
B.2	Evaluation	52
B.3	Evaluation of auxiliary energies	52
B.4	Further characteristics	52
B.5	Efficiency	53
B.6	View of yearly energy	53
Bibliography		54

Foreword

This document (EN 13053:2006+A1:2011) has been prepared by Technical Committee CEN/TC 156 “*Ventilation for buildings*”, the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2012, and conflicting national standards shall be withdrawn at the latest by January 2012.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes  EN 13053:2006 .

This document includes Amendment 1, approved by CEN on 2011-05-19.

The start and finish of text introduced or altered by amendment is indicated in the text by tags  .

This European Standard is a part of a series of standards for air handling units used for ventilation and air conditioning of buildings for human occupancy. It considers the ratings and the performance of air handling units as a whole, the requirements and performance of specific components and sections of air handling units including hygiene requirements. The position of this standard in the field of mechanical building services is shown in Figure 1.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

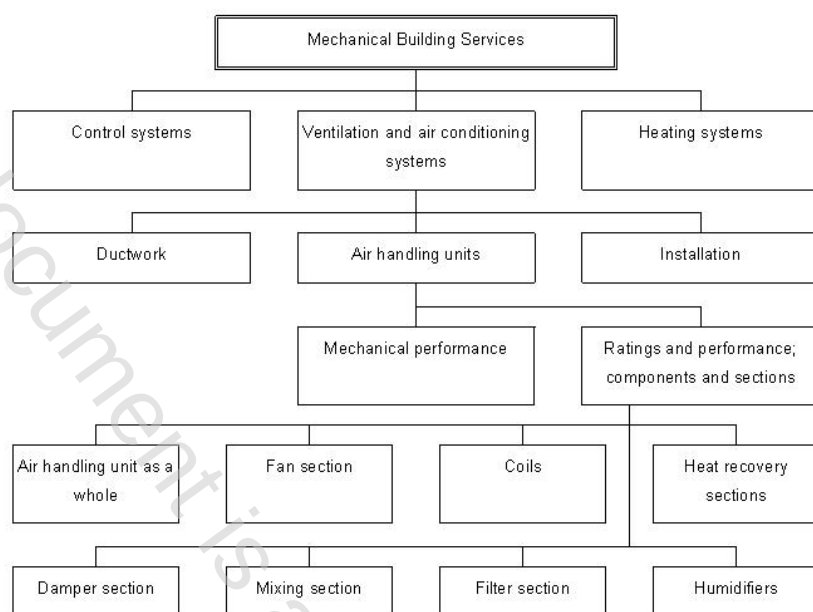


Figure 1 — Position of this standard in the field of mechanical building services

1 Scope

This European Standard specifies requirements and testing for ratings and performance of air handling units as a whole. It also specifies requirements, recommendations, classification, and testing of specific components and sections of air handling units. For many components and sections it refers to component standards, but it also specifies restrictions or applications of standards developed for stand alone components.

This standard is applicable both to standardised designs, which may be in a range of sizes having common construction concepts, and also to custom-design units. It also applies both to air handling units, which are completely prefabricated, and to units which are built up on site. Generally the units within the scope of this standard include at least a fan, a heat exchanger and an air filter.

This standard is not applicable to the following:

- a) air conditioning units serving a limited area in a building, such as fan coil units;
- b) units for residential buildings;
- c) units producing ventilation air mainly for a manufacturing process.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 308, *Heat exchangers — Test procedures for establishing performance of air to air and flue gases heat recovery devices*

EN 779, *Particulate air filters for general ventilation — Determination of the filtration performance*

EN 1216, *Heat exchangers — Forced circulation air-cooling and air-heating coils — Test procedures for establishing the performance*

EN 1751, *Ventilation for buildings — Air terminal devices — Aerodynamic testing of dampers and valves*

EN 1886:1998, *Ventilation for buildings — Air handling units — Mechanical performance*

EN 12792:2003, *Ventilation for buildings — Symbols, terminology and graphical symbols*

EN 13779, *Ventilation for non-residential buildings — Performance requirements for ventilation and room-conditioning systems*

EN ISO 3741, *Acoustics — Determination of sound power levels of noise sources using sound pressure — Precision methods for reverberation rooms (ISO 3741:1999)*

EN ISO 3744, *Acoustics — Determination of sound power levels of noise sources using sound pressure — Engineering method in an essentially free field over a reflecting plane (ISO 3744:1994)*

EN ISO 3746, *Acoustics — Determination of sound power levels of noise sources using sound pressure — Survey method using an enveloping measurement surface over a reflecting plane (ISO 3746:1995)*

EN ISO 5136, *Acoustics — Determination of sound power radiated into a duct by fans and other air-moving devices — In-duct method (ISO 5136:2003)*

EN ISO 5167-1, *Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full — Part 1: General principles and requirements* (ISO 5167-1:2003)

EN ISO 7235, *Acoustics — Laboratory measurement procedures for ducted silencers and air-terminal units — Insertion loss, flow noise and total pressure loss* (ISO 7235:2003)

ISO 5221, *Air distribution and air diffusion — Rules to methods of measuring air flow rate in an air-handling duct*

ISO 5801:1997, *Industrial fans — Performance testing using standardized airways*

ISO 13348 ^{A1}, *Industrial Fans — tolerances, methods of conversion and technical data presentation*