

EUROPEAN STANDARD

NORME EUROPÉENNE

EUROPÄISCHE NORM

EN 12390-3:2009/AC

August 2011

Août 2011

August 2011

ICS 91.100.30

English version
Version Française
Deutsche Fassung

Testing hardened concrete - Part 3: Compressive strength of test
specimens

Essais pour béton durci - Partie 3:
Résistance à la compression des
éprouvettes

Prüfung von Festbeton - Teil 3:
Druckfestigkeit von Probekörpern

This corrigendum becomes effective on 31 August 2011 for incorporation in the three official language versions of the EN.

Ce corrigendum prendra effet le 31 août 2011 pour incorporation dans les trois versions linguistiques officielles de la EN.

Die Berichtigung tritt am 31. August 2011 zur Einarbeitung in die drei offiziellen Sprachfassungen der EN in Kraft.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG


Management Centre: Avenue Marnix 17, B-1000 Brussels

© 2011 CEN All rights of exploitation in any form and by any means reserved worldwide for CEN national Members.
Tous droits d'exploitation sous quelque forme et de quelque manière que ce soit réservés dans le monde entier aux membres nationaux du CEN.
Alle Rechte der Verwertung, gleich in welcher Form und in welchem Verfahren, sind weltweit den nationalen Mitgliedern von CEN vorbehalten.

Ref. No.: EN 12390-3:2009/AC:2011 D/E/F

1 Modification to Clause 6 "Test report"

Replace the existing Figure 2 with the following: "

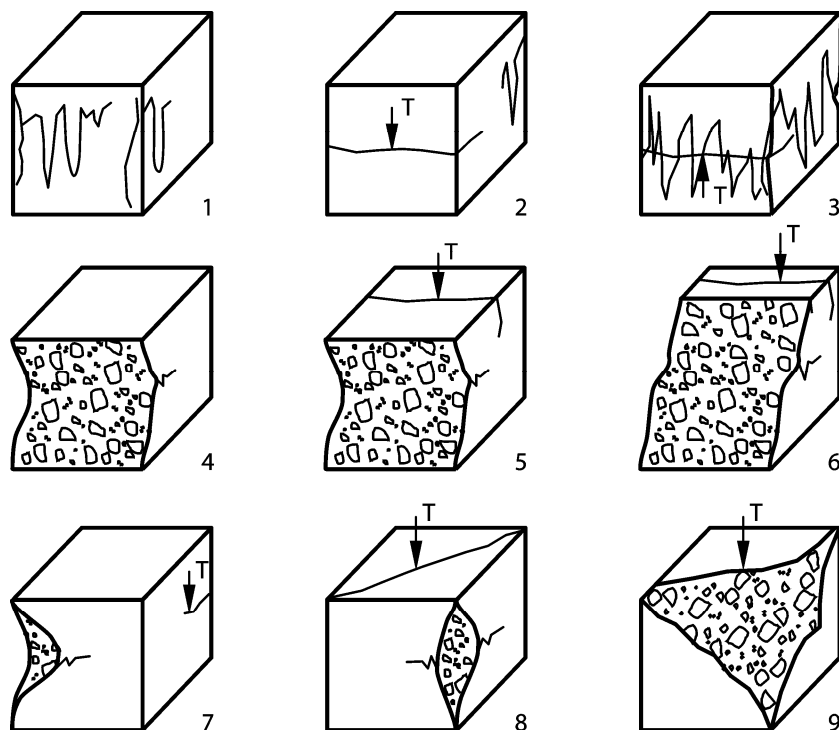

".

2 Modification to Clause 9 "Precision"

Replace the existing Table 2 with the following: "

Table 2 — Precision data for measurements of the compressive strength of hardened concrete, expressed as percentages of the mean of the three cylinder strengths whose differences are to be compared with repeatability (r) or reproducibility (R)

Test method	Repeatability conditions		Reproducibility conditions	
	s_r %	r %	s_R %	R %
cylinder (160 mm diameter, 320 mm height)	2,9	8,0	4,1	11,7

NOTE 1 The precision data were determined in France as part of a Round Robin Test carried out in 1992. They are based on the results obtained by 89 laboratories which had participated in the test.

NOTE 2 The concretes were made using CPA55 cement (CEMI), Seine river sand and 20 mm aggregate. The average value was 38,87 MPa.

NOTE 3 The precision data only includes the procedure of testing for compressive strength.

".