

INTERNATIONAL STANDARD

IEC
60044-8

First edition
2002-07

Instrument transformers –

Part 8: Electronic current transformers

Transformateurs de mesure –

*Partie 8:
Transformateurs de courant électroniques*



Reference number
IEC 60044-8:2002(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site (www.iec.ch/catlg-e.htm) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications (www.iec.ch/JP.htm) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch

Tel: +41 22 919 02 11

Fax: +41 22 919 03 00

INTERNATIONAL STANDARD

IEC
60044-8

First edition
2002-07

Instrument transformers –

Part 8: Electronic current transformers

Transformateurs de mesure –

*Partie 8:
Transformateurs de courant électroniques*

© IEC 2002 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: inmail@iec.ch Web: www.iec.ch



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

PRICE CODE

XF

For price, see current catalogue

CONTENTS

FOREWORD	6
1 Scope	7
1.1 General	7
1.2 General block diagram of electronic current transformers	8
1.3 General block diagram of electronic transformers with a digital output	9
2 Normative references	9
3 Definitions	12
3.1 General definitions	12
3.2 Additional definitions for measuring electronic current transformers	19
3.3 Additional definitions for protective electronic current transformers	19
3.4 Additional definitions for digital output	22
3.5 Additional definitions for analogue voltage output	23
3.6 Index of main definitions and abbreviations	23
4 Normal and special service conditions	24
4.1 General	24
4.2 Normal service conditions	25
4.3 Special service conditions	26
4.4 System earthing	28
5 Ratings	28
5.1 General ratings	28
5.2 Standard values for rated phase offset	32
5.3 Rating for digital output	32
5.4 Rating for analogue voltage output	33
6 Design requirements	34
6.1 General design requirements	34
6.2 Design requirements for digital output	43
6.3 Design requirements for analogue voltage output	60
7 Classification of tests	60
7.1 General	60
7.2 Type tests	60
7.3 Routine tests	61
7.4 Special tests	62
8 Type test	62
8.1 Short-time current tests	62
8.2 Temperature-rise test	63
8.3 Impulse tests on primary terminals	63
8.4 Wet test for outdoor type electronic current transformers	65
8.5 RIV tests	65
8.6 Transmitted overvoltage test	65
8.7 Low-voltage components voltage withstand test	66
8.8 EMC tests	67
8.9 Accuracy test	70
8.10 Additional accuracy tests for protective electronic current transformers	72
8.11 Verification of the protection	72
8.12 Tightness tests	73
8.13 Vibration tests	73
8.14 Additional type test for digital output	74

9	Routine tests.....	75
9.1	Verification of terminal markings	75
9.2	Power-frequency withstand tests on primary terminals and partial discharge measurement.....	75
9.3	Power-frequency voltage withstand test for low-voltage components.....	75
9.4	Accuracy tests	75
9.5	Tightness tests	75
9.6	Additional routine tests for digital output.....	76
9.7	Additional routine tests for analogue output	76
10	Special tests	76
10.1	Chopped lightning-impulse test on primary terminals	76
10.2	Measurement of capacitance and dielectric dissipation factor	76
10.3	Mechanical tests	76
10.4	Tests for accuracy versus harmonics	77
10.5	Tests in accordance with the technology applied	78
11	Marking.....	78
11.1	Terminal marking – General rules	78
11.2	Rating plate markings	79
12	Additional requirements for measuring electronic current transformers	82
12.1	Accuracy class designation	82
12.2	Limits of current error and phase error at rated frequency.....	82
12.3	Accuracy requirements on harmonics.....	83
13	Additional requirements for protective electronic current transformers	83
13.1	Accuracy classes	83
13.2	Accuracy requirements on harmonics.....	84
14	Information to be given with enquiries, tenders and orders.....	84
14.1	Designation.....	84
14.2	Dependability	85
15	Rules for transport, storage and installation.....	85
15.1	Conditions during transport, storage and installation.....	86
15.2	Installation	86
15.3	Unpacking and lifting.....	86
15.4	Assembly.....	86
15.5	Operation.....	87
15.6	Maintenance	87
16	Safety.....	90
16.1	Electrical aspects.....	90
16.2	Mechanical aspects.....	90
16.3	Thermal aspects	90
	Annex A (informative) Transient performances of ECTs	91
	Annex B (informative) Technical information for electronic current transformers with digital output	98
	Annex C (informative) Technical information for electronic current transformers with analogue output	108
	Annex D (normative) Frequency response and accuracy requirements on harmonics for electronic current and voltage transformer	116
	Annex E (informative) Graph explaining the accuracy requirements.....	123

Bibliography	124
Figure 1 – General block diagram of a single-phase electronic current transformer	8
Figure 2 – Example of digital interface block diagram.....	9
Figure 3 – Altitude correction factor	27
Figure 4 – Manchester coding.....	43
Figure 5 – Characteristics of the optical pulse.....	45
Figure 6 – Test circuit for the optical pulse.....	45
Figure 7 – Copper wire interface	47
Figure 8 – Eye diagram	48
Figure 9 – Daisy-chain architecture.....	49
Figure 10 – Frame format according to FT3	51
Figure 11 – Status word #1.....	56
Figure 12 – Status word #2.....	57
Figure 13 – Universal frame.....	58
Figure 14 – Pulse shape for clock input	59
Figure 15 – Example of subassembly subjected to EMC tests	68
Figure 16 – Temperature cycle accuracy test	71
Figure A.1 – Equivalent electrical circuit of the network	91
Figure A.2 – More complex equivalent electrical circuit during short circuit.....	92
Figure A.3 – Equivalent electrical circuit of magnetic current transformer during short circuit..	93
Figure A.4 – Magnetic reactance of the a CT without remanence	93
Figure A.5 – Magnetic reactance of the CT with remanence	94
Figure A.6 – Example of magnetic reactance of the a CT for a TPZ class.....	95
Figure A.7 – Example of the magnetic reactance of a CT for a TPY class.....	96
Figure B.1 – Combination of ECTs and EVT's to form the digital output.....	98
Figure B.2 – Synchronized samples of current from bay 1 and bay 2 calculated from non-synchronized samples from bay 1 and bay 2 respectively.....	101
Figure B.3 – Samples from current in bay 1 and 2 sampled synchronized by a common clock.....	101
Figure B.4 – Phase error definition for the digital interface	102
Figure B.5 – Test set-up	103
Figure B.6 – Comparison of errors in conventional metering systems and systems based on ECTs and EVT's with digital output	107
Figure C.1 – Test circuit for accuracy measurements in steady state.....	109
Figure C.2 – Iron-core-coil transformer	110
Figure C.3 – Equivalent circuit of the iron-core current transformer with voltage output.....	111
Figure C.4 – Stand-alone air-core coil.....	112
Figure C.5 – Equivalent circuit of stand-alone air-core current transformer with voltage output	113
Figure C.6 – Phasor diagram – Stand-alone air-core coil.....	114
Figure D.1 – Digital data acquisition system.....	118
Figure E.1 – Accuracy limits of a multi-purpose ECT	123

Table 1 – Temperature categories	25
Table 2 – Limits of temperature rise of the transformer	30
Table 3 – DC voltage	31
Table 4 – AC voltage	31
Table 5 – Rated values for digital output	32
Table 6 – Low-voltage withstand capability	34
Table 7 – Creepage distances for given pollution levels	35
Table 8 – Immunity requirements and tests	37
Table 9 – Static withstand test loads	39
Table 10 – The compatible fibre optic transmission system	44
Table 11 – The compatible copper-wire transmission system for simplex point-to-point link	46
Table 12 – Data channel mapping for DataSetName = 01, general application	53
Table 13 – Connectors	60
Table 14 – Modalities of application of test loads to be applied to the primary terminals	77
Table 15 – Markings of terminals	78
Table 16 – Rating plate marking	80
Table 17 – Limits of error	82
Table 18 – Limits of error for current transformers for special application	82
Table 19 – Limits of error	83
Table 20 – Limits of error	84
Table 21 – Designation of an electronic current transformer	85
Table B.1 – Sample application specific assignment of the data channels with DataSetName = FE H. Application for line protection and synchronization of 1½-beaker arrangements with combined ECTs/EVTs on both sides of the breakers	99

INTERNATIONAL ELECTROTECHNICAL COMMISSION

INSTRUMENT TRANSFORMERS –

Part 8: Electronic current transformers

FOREWORD

- 1) The IEC (International Electrotechnical Commission) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of the IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, the IEC publishes International Standards. Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. The IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of the IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested National Committees.
- 3) The documents produced have the form of recommendations for international use and are published in the form of standards, technical specifications, technical reports or guides and they are accepted by the National Committees in that sense.
- 4) In order to promote international unification, IEC National Committees undertake to apply IEC International Standards transparently to the maximum extent possible in their national and regional standards. Any divergence between the IEC Standard and the corresponding national or regional standard shall be clearly indicated in the latter.
- 5) The IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with one of its standards.
- 6) Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. The IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60044-8 has been prepared by IEC technical committee 38: Instrument transformers.

The text of this standard is based on the following documents:

FDIS	Report on voting
38/280/FDIS	38/282/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

Annexes A, B, C and E are for information only.

Annex D forms an integral part of this standard.

The committee has decided that the contents of this publication will remain unchanged until 2005. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

INSTRUMENT TRANSFORMERS –

Part 8: Electronic current transformers

1 Scope

1.1 General

This part of IEC 60044 applies to newly manufactured electronic current transformers having an analogue voltage output or a digital output, for use with electrical measuring instruments and electrical protective devices at nominal frequencies from 15 Hz to 100 Hz.

NOTE Additional requirements due to the bandwidth are considered. The accuracy requirements on harmonics are given in annex D.

Clause 12 covers the accuracy requirements that are necessary for electronic current transformers for use with electrical measuring instruments.

Clause 13 covers the accuracy requirements that are necessary for electronic current transformers for use with electrical protective relays, and particularly for forms of protection in which the prime requirement is to maintain the accuracy up to several times the rated current. If required, the transient accuracy of an electronic current transformer during fault is also given in this clause.

Electronic current transformers intended for both measurement and protection should comply with all the clauses of this standard and are called multipurpose electronic current transformers.

The transformer technology can be based on optical arrangements equipped with electrical components, on air-core coils (with or without a built-in integrator), or on iron-core coils with integrated shunt used as a current-to-voltage converter, alone or equipped with electronic components.

For analogue output, the electronic current transformer may include the secondary signal cable. Examples of electronic current transformer technologies using air-core coils and iron-core coils with integrated shunt are given in annex C.

For digital output, this standard takes into account a point-to-point connection from the electronic transformer to electrical measuring instruments and electrical devices (see annex B).

Some information has been added in order to ensure the compatibility of this point-to-point link with the overall system of communication in the substation, thus allowing data exchange between all kinds of substation devices. This information builds what is called the mapping of the link layer of the point-to-point serial link. Processbus communication is under consideration.

This mapping allows interoperability between devices from different manufacturers.


This standard does not specify individual implementations or products, nor does it constrain the implementation of entities and interfaces within a computer system. This standard specifies the externally visible functionality of implementations together with conformance requirements for such functionalities.

NOTE 1 Translation of the analogue requirements on CT and VT into digital parameters, such as the number of bits and the sampling speed, has been carried out as far as was reasonable, since the requirements on the conventional CT and VT are expressed according to the actual technologies used and their shortcomings, rather than on needs from the equipment using the information on current and voltage.

NOTE 2 The approach chosen is to concentrate on what is needed by the secondary equipment and how the performance can be calibrated. The concept is compatible with a processbus.

1.2 General block diagram of electronic current transformers

The applied technology decides which parts are necessary for the realization of an electronic current transformer, i.e. it is not absolutely necessary that all the parts described in figures 1 and 2 be included in the transformer.

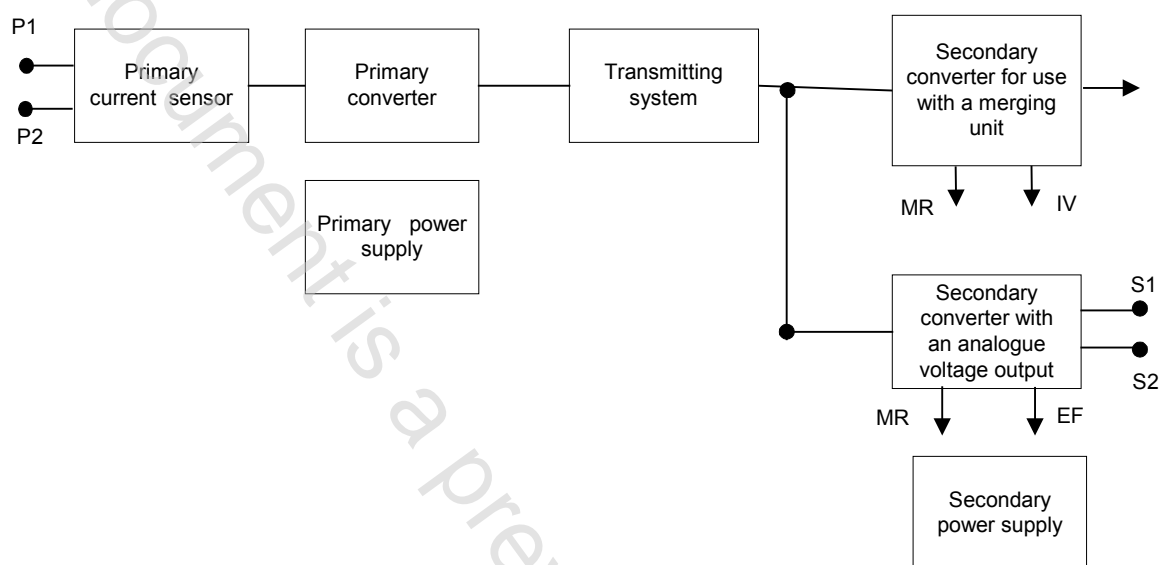


IEC 1732/02

Key

- IV Output invalid
- EF Equipment failure
- MR Maintenance request

Figure 1 – General block diagram of a single-phase electronic current transformer

1.3 General block diagram of electronic transformers with a digital output

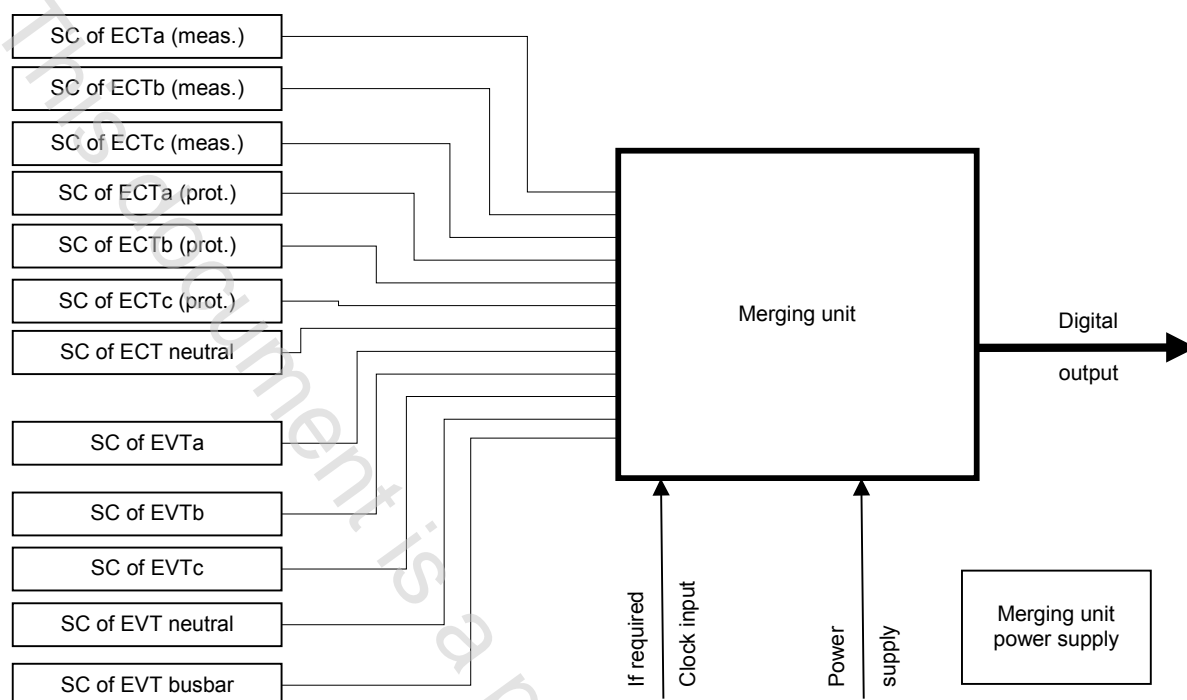

IEC 1733/02

NOTE SC of EVTa is the secondary converter of the electronic voltage transformer of phase a (see IEC 60044-7). SC of ECTa is the secondary converter of the electronic current transformer of phase a. Other data channel mappings are possible (see 6.2.3).

Figure 2 – Example of digital interface block diagram

Up to 12 secondary converter data channels are grouped together (merged) using a merging unit (MU). A data channel carries a single stream of sampled measurement values from an electronic current transformer or an electronic voltage transformer (see figure 2). Several data channels may be transmitted via one physical interface from the secondary converter to the merging unit in case of multiphase or combined units. The merging unit supplies the secondary equipment with a time-coherent set of current and voltage samples. A secondary converter can be used also for the acquisition of signals coming from conventional voltage instrument transformers or current instrument transformers and may be integrated into the merging unit.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60028:1925, *International standard of resistance for copper*

IEC 60044-1, *Instrument transformers – Part 1: Current transformers*

IEC 60044-6, *Instrument transformers – Part 6: Requirements for protective current transformers for transient performance*

IEC 60044-7, *Instrument transformers – Part 7: Electronic voltage transformers*

IEC 60050(161):1990, *International Electrotechnical Vocabulary (IEV) – Chapter 161: Electromagnetic compatibility*

IEC 60050(321):1986, *International Electrotechnical Vocabulary – Chapter 321: Instrument transformers*

IEC 60050(601):1985, *International Electrotechnical Vocabulary (IEV) – Chapter 601: Generation, transmission and distribution of electricity – Generation*

IEC 60050(604):1987, *International Electrotechnical Vocabulary (IEV) – Chapter 604: Generation, transmission and distribution of electricity – Operation*

IEC 60056, *High voltage alternating current circuit-breakers*

IEC 60060-1:1989, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60068-2-6:1995, *Environmental testing – Part 2: Tests – Test Fc: Vibration (sinusoidal)*

IEC 60068-2-17: *Environmental testing – Part 2: Tests – Test Q: Sealing*

IEC 60068-2-75: *Environmental testing – Part 2: Tests – Test Eh: Hammer test*

IEC 60071-1:1993, *Insulation co-ordination – Part 1: Definitions, principles and rules*

IEC 60085:1984, *Thermal evaluation and classification of electrical insulation*

IEC 60121, *Recommendation for commercial annealed aluminium electrical conductor wire*

IEC 60255-5:2000, *Electrical relays – Part 5: Insulation coordination for measuring relays and protection equipment – Requirements and tests*

IEC 60255-22-1:1988, *Electrical relays – Part 22: Electrical disturbance tests for measuring relays and protection equipment – Section 2: Electrostatic discharge tests*

IEC 60296:1982, *Specification for unused mineral insulating oils for transformers and switchgear*

IEC 60304:1982, *Standard colours for insulation for low-frequency cables and wires*

IEC 60376:1971, *Specification and acceptance of new sulphur hexafluoride*

IEC 60376B:1974, *Specification and acceptance of new sulphur hexafluoride – Second supplement – Clause 26*

IEC 60417 (all parts), *Graphical symbols for use on equipment*

IEC 60480:1974, *Guide to the checking of sulphur hexafluoride (SF₆) taken from electrical equipment*

IEC 60529, *Degrees of protection provided by enclosures (IP code)*

IEC 60664-1:1992, *Insulation co-ordination for equipment within low-voltage systems – Part 1: Principles, requirements and tests*

IEC 60694, *Common specifications for high-voltage switchgear and controlgear standards*

IEC 60707:1999, *Flammability of solid non-metallic materials when exposed to flame sources – List of test methods*

IEC 60721-3-3:1994, *Classification of environmental conditions – Part 3: Classification of groups of environmental parameters and their severities – Section 3: Stationary use at weather-protected locations*

IEC 60721-3-4:1995, *Classification of environmental conditions – Part 3: Classification of groups of environmental parameters and their severities – Section 4: Stationary use at non-weather-protected locations*

IEC 60794 (all parts), *Optical fibre cables*

IEC 60812:1985, *Analysis techniques for system reliability – Procedure for failure mode and effects analysis (FMEA)*

IEC 60815:1986, *Guide for the selection of insulators in respect of polluted conditions*

IEC 60870-5-1:1990, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section One: Transmission frame formats*

IEC 61000-4-1:2000, *Electromagnetic compatibility (EMC) – Part 4-1: Testing and measurement techniques – Overview of IEC 61000-4 series*

IEC 61000-4-2: *Electromagnetic compatibility (EMC) – Part 4-2: Testing and measurement techniques – Electrostatic discharge immunity test*

IEC 61000-4-3: *Electromagnetic compatibility (EMC) – Part 4-3: Testing and measurement techniques – Radiated, radio-frequency, electromagnetic field immunity test*

IEC 61000-4-4:1995, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 4: Electrical fast transient/burst immunity test – Basic EMC publication*

IEC 61000-4-5: *Electromagnetic compatibility (EMC) – Part 4-5: Testing and measurement techniques – Surge immunity test*

IEC 61000-4-7:1991, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 7: General guide on harmonics and interharmonics measurements and instrumentation, for power supply systems and equipment connected thereto*

IEC 61000-4-8: *Electromagnetic compatibility (EMC) – Part 4-8: Testing and measurement techniques – Power frequency magnetic field immunity test*

IEC 61000-4-9: *Electromagnetic compatibility (EMC) – Part 4-9: Testing and measurement techniques – Pulse magnetic field immunity test*

IEC 61000-4-10: *Electromagnetic compatibility (EMC) – Part 4-10: Testing and measurement techniques – Damped oscillatory magnetic field immunity test*

IEC 61000-4-11: *Electromagnetic compatibility (EMC) – Part 4-11: Testing and measurement techniques – Voltage dips, short interruptions and voltage variations immunity tests*

IEC 61000-4-12: *Electromagnetic compatibility (EMC) – Part 4-12: Testing and measurement techniques – Oscillatory waves immunity test*

IEC 61000-4-13: *Electromagnetic compatibility (EMC) – Part 4-13: Testing and measurement techniques – Harmonics and interharmonics including mains signalling at a.c. power port, low frequency immunity tests*

IEC 61000-4-29:2000, *Electromagnetic compatibility (EMC) – Part 4-29: Testing and measurement techniques – Voltage dips, short interruptions and voltage variations on d.c. input power port immunity tests*

IEC 61025:1990, *Fault tree analysis (FTA)*

IEC 61166:1993, *High-voltage alternating circuit-breakers – Guide for seismic qualification of high-voltage alternating current*

IEC/TS 61462:1998, *Composite insulators – Hollow insulators for use in outdoor and indoor electrical equipment – Definitions, test methods, acceptance criteria and design recommendations*

IEC 61850-3: *Communication networks and systems in substations – Part 3: General requirements*

IEC 61850-9-1: *Communication networks and systems in substations – Part 9-1: Specific communication system mappings (SCSM) – Serial unidirectional multidrop point-to-point link*¹

CISPR 11:1999, *Industrial scientific and medical (ISM) radio-frequency equipment – Electro-magnetic disturbance characteristics – Limits and methods of measurement*

EIA RS-485: *Standard for electrical characteristics of generators and receivers for use in balanced digital multipoint systems*

EN 50160:2000, *Voltage characteristics of electricity supplied by public distribution system*

3 Definitions

For the purposes of this part of IEC 60044, the following definitions apply.

3.1 General definitions

3.1.1

electronic instrument transformer

arrangement consisting of one or more current or voltage sensor(s) which may be connected to transmitting systems and secondary converters, all intended to transmit a measuring quantity in a proportional quantity to supply measuring instruments, meters and protective or control devices. In case of a digital interface this is done by using a merging unit for a set of electronic instrument transformers

3.1.2

electronic current transformer (ECT)

electronic instrument transformer in which the output of the secondary converter in normal conditions of use is substantially proportional to the primary current and differs in phase from it by a known angle for an appropriate direction of the connections

3.1.3

primary terminals

terminals through which the current to be measured flows

3.1.4

primary current sensor

electric, electrical, optical or other device intended to transmit a signal corresponding to the current flowing through the primary terminals to the secondary converter, either directly or by means of a primary converter

3.1.5

primary converter

arrangement that converts the signal coming from one or more primary current sensors into a signal suitable for the transmitting system

3.1.6

primary power supply

power supply to the primary converter and/or primary current sensor (can be combined with secondary power supply (see 3.1.10))

¹ To be published.