

**Open Data Communication in Building Automation,
Controls and Building Management - Home and Building
Electronic Systems - Part 2: KNXnet/IP Communication**

EESTI STANDARDI EESSÕNA

NATIONAL FOREWORD

See Eesti standard EVS-EN 13321-2:2012 sisaldab Euroopa standardi EN 13321-2:2012 ingliskeelset teksti.	This Estonian standard EVS-EN 13321-2:2012 consists of the English text of the European standard EN 13321-2:2012.
Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas.	This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation.
Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 12.12.2012.	Date of Availability of the European standard is 12.12.2012.
Standard on kättesaadav Eesti Standardikeskusest.	The standard is available from the Estonian Centre for Standardisation.

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile standardiosakond@evs.ee.

ICS 35.240.99, 97.120

Standardite reprodutseerimise ja levitamise õigus kuulub Eesti Standardikeskusele

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonsesse süsteemi või edastamine ükskõik millises vormis või millisel teel ilma Eesti Standardikeskuse kirjaliku loata on keelatud.

Kui Teil on küsimusi standardite autorikaitse kohta, võtke palun ühendust Eesti Standardikeskusega:
Aru 10, 10317 Tallinn, Eesti; www.evs.ee; telefon 605 5050; e-post info@evs.ee

The right to reproduce and distribute standards belongs to the Estonian Centre for Standardisation

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without a written permission from the Estonian Centre for Standardisation.

If you have any questions about copyright, please contact Estonian Centre for Standardisation:
Aru 10, 10317 Tallinn, Estonia; www.evs.ee; phone 605 5050; e-mail info@evs.ee

English Version

**Open Data Communication in Building Automation, Controls and
Building Management - Home and Building Electronic Systems -
Part 2: KNXnet/IP Communication**

Réseau ouvert de communication de données pour
l'automatisation, la régulation et la gestion technique du
bâtiment - Systèmes électroniques pour la maison et le
bâtiment - Partie 2: Communication KNXnet/IP

Offene Datenkommunikation für die Gebäudeautomation
und Gebäudemanagement - Elektrische Systemtechnik für
Heim und Gebäude - Teil 2: KNXnet/IP-Kommunikation

This European Standard was approved by CEN on 30 September 2012.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	4
Introduction	5
1 Scope	7
2 Normative references	8
3 Terms and definitions	8
4 Symbols and abbreviations	10
5 Requirements	11
5.1 Clause 1: Overview	11
5.1.1 KNXnet/IP Document Clauses	11
5.1.2 Mandatory and optional implementation of IP protocols	13
5.1.3 Security considerations	15
5.2 Clause 2: Core	17
5.2.1 Scope	17
5.2.2 KNXnet/IP frames	17
5.2.3 Host protocol independence	19
5.2.4 Discovery and self description	20
5.2.5 Communication Channels	21
5.2.6 General implementation guidelines	24
5.2.7 Data Packet structures	28
5.2.8 IP Networks	42
5.2.9 Certification	47
5.3 Clause 3: Device Management Specification	48
5.3.1 Scope	48
5.3.2 KNXnet/IP Device Management	48
5.3.3 Implementation rules and guidelines	60
5.3.4 Data packet structures	62
5.3.5 Certification	65
5.4 Clause 4: Tunnelling	66
5.4.1 Scope	66
5.4.2 Tunnelling of KNX telegrams	66
5.4.3 Configuration and Management	70
5.4.4 Frame structures	70
5.4.5 Certification	72
5.5 Clause 5: Routing	73
5.5.1 Scope	73
5.5.2 KNXnet/IP Routing of KNX telegrams	73
5.5.3 Implementation rules and guidelines	80
5.5.4 Configuration and Management	83
5.5.5 Data packet structures	83
5.5.6 Certification	85
5.6 Clause 6: Remote Diagnosis and Configuration	86
5.6.1 Scope	86
5.6.2 Remote Diagnosis of KNXnet/IP devices	87
5.6.3 Configuration and Management	87
5.6.4 Data packet structures	88
5.6.5 Certification	93
Annex A (normative) List of codes	94
Annex B (informative) Binary examples of KNXnet/IP IP frames	103
Annex C (normative) KNXnet/IP Parameter Object	122

Annex D (normative) Common External Messaging Interface (cEMI)	125
Annex E (normative) Coupler Resources	158
Bibliography	170

This document is a preview generated by EVS

Foreword

This document (EN 13321-2:2012) has been prepared by Technical Committee CEN/TC 247 “Building Automation, Controls and Building Management”, the secretariat of which is held by SNV.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 2013, and conflicting national standards shall be withdrawn at the latest by June 2013.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 13321-2:2006.

Whereas ENV 13321-2:2000 described the transmission of EIB packets over Ethernet including the frame encoding, this document describes the transmission of HBES packets using the Internet Protocol. Details of the HBES packet frames are covered in part 1 of EN 13321, removing the need to explicitly describe the HBES frames in this document.

This document is Part 2 of the EN 13321 series of European Standards under the general title *Open data communication in building automation, controls and building management — Home and building electronic systems*, which consists of the following parts:

- *Part 1: Product and system requirements;*
- *Part 2: KNXnet/IP communication.*

According to the CEN/CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Introduction

This European Standard is intended for the design of new buildings and the retrofit of existing buildings in terms of acceptable indoor environment, practical energy conservation and efficiency.

This standard defines the integration of KNX protocol implementations within the Internet Protocol (IP) named KNXnet/IP. It defines a standard protocol, which is implemented within KNX devices, Engineering Tool Software (ETS) and other implementations to support KNX data exchange over IP networks. In fact, KNXnet/IP provides a general framework, which accommodates several specialised “Service Protocols” in a modular and extendible fashion.

The KNXnet/IP standard consists of the following clauses:

- Clause 1, Overview
- Clause 2, Core Specification
- Clause 3, Device Management
- Clause 4, Tunnelling
- Clause 5, Routing
- Clause 6, Remote Diagnosis and Configuration

Additional clauses may be added to the KNXnet/IP standard in the future at which time Clause 1 “Overview” as well as Annex A will need to be updated.

KNXnet/IP supports different software implementations on top of the protocol. More specifically, these software implementations can be Building Management, Facility Management, Energy Management, or simply Data Base and SCADA (Supervision, Control and Data Acquisition) packages.

Most of these packages need to be configured for the specific user application. In order to simplify this process and cut costs for engineering, KNXnet/IP provides simple engineering interfaces, namely a description “language” for the underlying KNX system. This may be done off-line, e.g. generated as an ETS export file, or on-line by a mechanism that self-describes the underlying KNX system (reading data from the system itself).

In conjunction with the EIB/KNX-to-BACnet mapping described in EN ISO 16484-5, EIB/KNX installations can very easily be integrated into BACnet system environments.

KNXnet/IP supports:

- on-the-fly change-over between Operational modes (configuration, operation);
- event driven mechanisms;
- connections with a delay time greater than $t_{\text{EIB_transfer_timeout}}$ (e.g. network connection via satellite).

Clause 1, Overview

Clause 1 “Overview” provides a general overview of KNXnet/IP and covers security considerations.

Clause 2, Core specification

Clause 2 “Core Specification” defines a standard protocol which is implemented within KNXnet/IP devices and Engineering Tool Software to support KNX data exchange over IP networks.

This specific implementation of the protocol over the Internet Protocol (IP) is called KNXnet/IP.

This standard addresses:

- definition of data packets sent over the IP host protocol network for KNXnet/IP communication;
- discovery and self-description of KNXnet/IP servers;
- configuration and establishment of a communication channel between a KNXnet/IP client and a KNXnet/IP server.

Clause 3, Device Management

Clause 3 “Device Management” defines services for remote configuration and remote management of KNXnet/IP servers.

Clause 4, Tunnelling

Clause 4 “Tunnelling” defines services for point-to-point exchange of KNX telegrams over an IP network between a KNXnet/IP device acting as a server and a KNXnet/IP Client. This point-to-point exchange may be established by a super ordinate system for building automation or management functions or by an Engineering Tool Software. It supports all ETS functions for download, test, and analysis of KNX devices on KNX networks connected via KNXnet/IP servers. This includes changes of single KNX device object properties.

Tunnelling assumes that a data transmission round-trip between a KNXnet/IP Tunnelling client and KNXnet/IP servers takes less than $t_{\text{KNX_transfer_timeouts}}$.

Clause 5, Routing

Clause 5 “Routing” defines services for a point-to-multipoint exchange of KNX telegrams over an IP network between KNXnet/IP routers and/or KNX/IP devices.

Clause 6, Remote Diagnosis and Configuration

Clause 6 “Remote Diagnosis and Configuration” defines services for a point-to-point exchange of KNX telegrams over an IP network between KNXnet/IP routers and/or KNX/IP devices. The services provide means for diagnosing communication settings and for changing these remotely.

1 Scope

This European Standard defines the integration of KNX protocol implementations on top of Internet Protocol (IP) networks, called KNXnet/IP. It describes a standard protocol for KNX devices connected to an IP network, called KNXnet/IP devices. The IP network acts as a fast (compared to KNX transmission speed) backbone in KNX installations.

Widespread deployment of data networks using the Internet Protocol (IP) presents an opportunity to expand building control communication beyond the local KNX control bus, providing:

- remote configuration;
- remote operation (including control and annunciation);
- fast interface from LAN to KNX and vice versa;
- WAN connection between KNX systems (where an installed KNX system is at least one line).

A KNXnet/IP system contains at least these elements:

- one EIB line with up to 64 (255) EIB devices;
OR
one KNX segment (KNX-TP1, KNX-TP0, KNX-RF, KNX-PL110, KNX-PL132);
- a KNX-to-IP network connection device (called KNXnet/IP server);

and typically additional

- software for remote functions residing on e.g. a workstation (may be data base application, BACnet Building Management System, browser, etc.).

Figure 1 shows a typical scenario where a KNXnet/IP client (e.g. running ETS) accesses multiple KNX installed systems or KNX subnetworks via an IP network. The KNXnet/IP client may access one or more KNXnet/IP servers at a time. For subnetwork, routing server-to-server communication is possible.

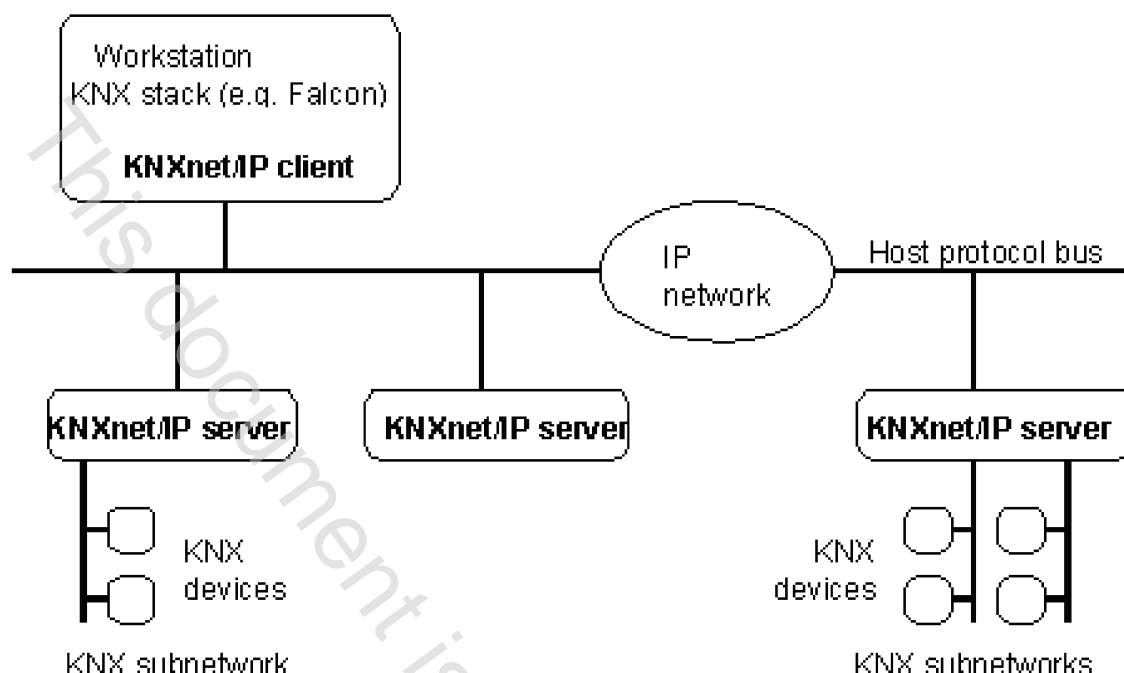


Figure 1 — Device types and configuration examples

2 Normative references

Not applicable.

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

subnet

portion of a network that shares a common address component known as the "subnet address"

Note 1 to entry: Different network protocols specify the subnet address in different ways.

3.2

Engineering Tool Software

ETS

software used to configure KNX devices

3.3

Host Protocol Address Information

HPAI

structure holding the IP host protocol address information used to address a KNXnet/IP endpoint on another KNXnet/IP device

3.4

communication channel

logical connection between a KNXnet/IP client and a KNXnet/IP server (or, in case of routing, between two or more KNXnet/IP servers)

Note 1 to entry: A communication channel consists of one or more connections on the definition of the host protocol used for KNXnet/IP.