

Telecommunications bonding networks for buildings
and other structures

EESTI STANDARDI EESSÕNA

NATIONAL FOREWORD

See Eesti standard EVS-EN 50310:2016 sisaldab Euroopa standardi EN 50310:2016 ingliskeelset teksti.	This Estonian standard EVS-EN 50310:2016 consists of the English text of the European standard EN 50310:2016.
Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas.	This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation.
Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 27.05.2016.	Date of Availability of the European standard is 27.05.2016.
Standard on kättesaadav Eesti Standardikeskusest.	The standard is available from the Estonian Centre for Standardisation.

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile standardiosakond@evs.ee.

ICS 29.120.50, 91.140.50

Standardite reprodutseerimise ja levitamise õigus kuulub Eesti Standardikeskusele

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonsesse süsteemi või edastamine ükskõik millises vormis või millisel teel ilma Eesti Standardikeskuse kirjaliku loata on keelatud.

Kui Teil on küsimusi standardite autorikaitse kohta, võtke palun ühendust Eesti Standardikeskusega:

Aru 10, 10317 Tallinn, Eesti; koduleht www.evs.ee; telefon 605 5050; e-post info@evs.ee

The right to reproduce and distribute standards belongs to the Estonian Centre for Standardisation

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without a written permission from the Estonian Centre for Standardisation.

If you have any questions about copyright, please contact Estonian Centre for Standardisation:

Aru 10, 10317 Tallinn, Estonia; homepage www.evs.ee; phone +372 605 5050; e-mail info@evs.ee

English Version

Telecommunications bonding networks for buildings and other structures

Application de liaison équipotentielle et de la mise à la terre
dans les locaux avec équipement de technologie de
l'information

Anwendung von Maßnahmen für Erdung und
Potentialausgleich in Gebäuden mit Einrichtungen der
Informationstechnik

This European Standard was approved by CENELEC on 2016-04-11. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

European foreword	4
Introduction	6
1 Scope	9
2 Normative references	9
3 Terms, definitions and abbreviations	10
3.1 Terms and definitions	10
3.2 Abbreviations	12
4 Conformance	13
5 Overview of bonding networks	13
6 Selection of the telecommunications bonding network approach	15
6.1 Assessment of the impact of the telecommunications bonding network on the interconnection of telecommunications equipment	15
6.2 Telecommunications bonding networks	16
6.3 Telecommunications bonding network performance	17
7 Common features	19
7.1 General	19
7.2 Protective bonding networks	19
7.3 Telecommunications entrance facility (TEF)	19
7.4 Telecommunications bonding network components	20
7.5 Cabinets, frames and racks	21
7.6 Miscellaneous bonding connections	24
7.7 Documentation	25
8 Dedicated telecommunications bonding network	25
8.1 General	25
8.2 Components	26
8.3 Implementation	30
9 Local telecommunications bonding networks in conjunction with protective bonding networks	33
9.1 Bonding for local distribution	33
9.2 Telecommunications bonding conductors	35
9.3 Bonding for areas of telecommunications equipment concentration	36
10 Local telecommunications bonding networks in conjunction with dedicated telecommunications bonding networks	36
10.1 Bonding for areas of telecommunications equipment concentration	36
10.2 Telecommunications equipment bonding conductors (TEBC)	37
11 Mesh bonded networks	38
11.1 General	38
11.2 Mesh bonding alternatives	38
11.3 Bonding conductors of a mesh bonding network	41
11.4 Bonding conductors to the mesh bonding network	41
11.5 Supplementary bonding grid (SBG)	42
11.6 System reference potential plane (SRPP).....	42
Annex A (normative) Maintenance of telecommunications bonding network performance	45
A.1 General	45
A.2 Periodic activity	45
A.2.1 Schedule	45
A.2.2 Implementation	45

A.3 Causes of performance deterioration.....	46
A.3.1 Galvanic corrosion.....	46
A.3.2 Requirements.....	46
Bibliography.....	47

This document is a preview generated by EVS

European foreword

This document (EN 50310:2016) was prepared by the CLC/TC 215, "Electrotechnical aspects of telecommunication equipment".

The following dates are fixed:

- latest date by which this document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2017-04-11
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) 2019-04-11

This document supersedes EN 50310:2010.

In 2012, EN 50310:2010 had been offered to ISO/IEC JTC 1/SC 25 "Interconnection of information technology equipment" as input to the agreed project to seek global harmonization of the technical requirements for telecommunications bonding networks. This project, ISO/IEC 30129, has been finished successfully. Thus, TC 215 decided to transpose ISO/IEC 30129 into the fourth edition of EN 50310 with minimal editorial changes to fit European needs. In this context, also the title of EN 50310 has been changed to adopt the title of ISO/IEC 30129.

EN 50310 has been produced within the framework of the following considerations.

- a) With the ongoing growth of the liberalised telecommunication market, the increasing advent of private telecommunication network operators, and the flourishing use of networking computers, the amount of Information Technology equipment installed in buildings and the complexity of these Information Technology installations are permanently growing.
- b) Information Technology equipment is generally installed either as stand-alone equipment (e.g. personal or network computers, small PBXs), or held in racks, cabinets or other mechanical structures (e.g. switching systems, transmission systems, mobile base stations).
- c) CENELEC/SC 64B „Electrical installations and protection against electric shock – Protection against thermal effects“ had decided during their meeting in November 1997 not to harmonize IEC 60364-5-548:1996 *“Electrical installations of buildings – Part 5: Selection and erection of electrical equipment – Section 548: Earthing arrangements and equipotential bonding for information technology installations”*.
- d) This European Standard shall give guidance to network operators, equipment providers and building owners to agree on a standardized bonding configuration that facilitates:
 - compliance of the Information Technology Equipment installation with functional requirements including Electromagnetic Compatibility (EMC) aspects of emission and immunity,
 - compatible building installation and equipment provisions,
 - installation of new equipment in buildings as well as expansion or replacement of installations in existing buildings with equipment coming from different suppliers,
 - a structured installation practice,
 - simple maintenance rules,

- contracting on a common basis,
- harmonization in development, manufacturing, installation and operation.

This document is a preview generated by EVS

Introduction

This European Standard

- 1) specifies assessment criteria to determine the relevant bonding configurations that are appropriate,
- 2) enables the implementation of any bonding configurations that may be necessary by means of either
 - the provision of a bonding network that utilizes the existing protective bonding network for electrical safety, or
 - the provision of a dedicated bonding network for the telecommunications infrastructure.

This standard is intended for

- building architects, owners and managers,
- designers and installers of electrical and telecommunications cabling installations.

Users of this standard should be familiar with all applicable cabling design and installation standards.

Figure 1 and Table 1 show the schematic and contextual relationships between the standards produced by TC 215 for information technology cabling, namely:

- installation specification, quality assurance, planning and installation practices (EN 50174 series);
- generic cabling design (EN 50173 series);
- application dependent cabling design (e.g. EN 50098 series);
- testing of installed cabling (EN 50346);
- this European Standard (EN 50310).

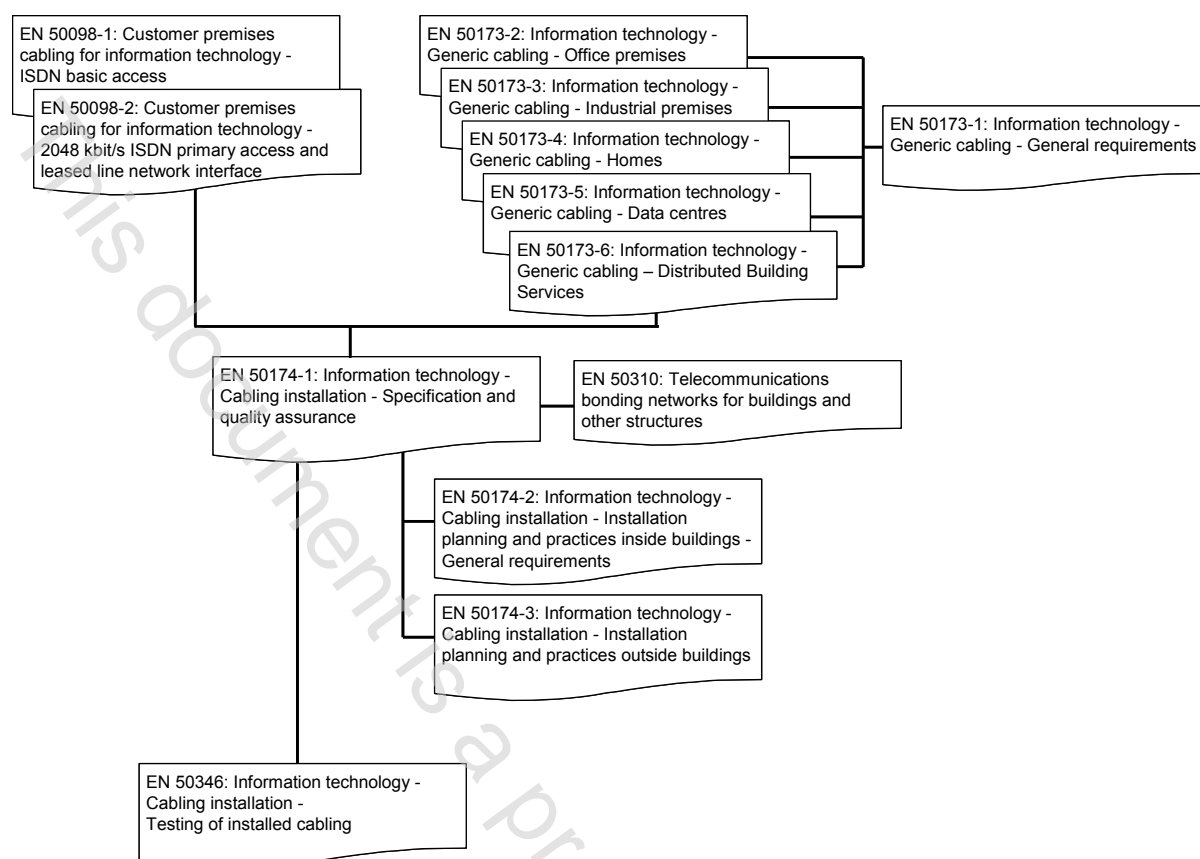


Figure 1 – Schematic relationship between EN 50310 and other relevant standards

Table 1 – Contextual relationship between EN 50310 and other relevant standards

Building design phase	Generic cabling design phase	Specification phase	Installation phase	Operation phase
EN 50310	EN 50173 series except EN 50173–4	EN 50174–1		EN 50174–1
6 Selection of bonding network	4 Structure	4 Requirements for specifying installations of information technology cabling		4 Requirements for specifying installations of information technology cabling
	5 Channel performance			
	7 Cable requirements	5 Requirements for installers of information technology cabling		
	8 Connecting hardware requirements			
	9 Requirements for cords and jumpers			
	A Link performance limits			
		Planning phase		
	and EN 50173–4	EN 50174–2	EN 50174–2	
	4 and 5 Structure	4 Requirements for planning installations of information technology cabling	5 Requirements for the installation of information technology cabling	
	6 Channel performance			
	8 Cable requirements	6 Segregation of metallic information technology cabling and mains power cabling	6 Segregation of metallic information technology cabling and mains power cabling	
	9 Connecting hardware requirements			
	10 Requirements for cords and jumpers	7 Electricity distribution systems and lightning protection		
	A Link performance limits	and EN 50174–3 and (for bonding) EN 50310	and EN 50174–3 and (for bonding) EN 50310 and EN 50346	
			4 General requirements	
			5 Test parameters for balanced cabling	
			6 Test parameters for optical fibre cabling	

1 Scope

This European Standard specifies requirements and provides recommendations for the design and installation of connections (bonds) between various electrically conductive elements in buildings and other structures, during their construction or refurbishment, in which information technology (IT) and, more generally, telecommunications equipment is intended to be installed in order to:

- a) minimize the risk to the correct function of that equipment and interconnecting cabling from electrical hazards;
- b) provide the telecommunications installation with a reliable signal reference – which may improve immunity from electromagnetic interference (EMI).

The requirements of this European Standard are applicable to the buildings and other structures within premises addressed by EN 50174-2 (e.g. residential, office, industrial and data centres) but information given in this European Standard may be of assistance for other types of buildings and structures.

NOTE Telecommunications centres (operator buildings) are addressed by ETSI/EN 300 253.

This European Standard does not apply to power supply distribution of voltages over AC 1 000 V.

Electromagnetic compatibility (EMC) requirements and safety requirements for power supply installation are outside the scope of this European Standard and are covered by other standards and regulations. However, information given in this European Standard may be of assistance in meeting the requirements of these standards and regulations.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50083 series ¹⁾, *Cable networks for television signals, sound signals and interactive services*

EN 50174-2:2009, *Information technology – Cabling installation – Part 2: Installation planning and practices inside buildings*

EN 50174-2:2009/A1:2011, *Information technology – Cabling installation – Part 2: Installation planning and practices inside buildings*

EN 60728 series, *Cable networks for television signals, sound signals and interactive services (IEC 60728 series)*

EN 61140, *Protection against electric shock - Common aspects for installation and equipment (IEC 61140)*

EN 62305-4, *Protection against lightning - Part 4: Electrical and electronic systems within structures (IEC 62305-4)*

HD 60364-4-41, *Low-voltage electrical installations – Part 4-41: Protection for safety – Protection against electric shock (IEC 60364-4-41)*

HD 60364-4-444, *Low-voltage electrical installations – Part 4-444: Protection for safety – Protection against voltage disturbances and electromagnetic disturbances (IEC 60364-4-44)*

¹⁾ Being partly replaced by EN 60728 series.

HD 60364-5-54, *Low-voltage electrical installations – Part 5-54: Selection and erection of electrical equipment – Earthing arrangements, protective conductors and protective bonding conductors (IEC 60364-5-54)*

3 Terms, definitions and abbreviations

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 50174-2 and the following apply.

3.1.1

access provider

operator or another entity providing the means to enable external telecommunications services provision to a subscriber

[SOURCE: EN 50700:2014, 3.1.3]

3.1.2

asymmetric cabling

cabling within which the cable elements are asymmetric (unbalanced)

3.1.3

application

system, with its associated transmission method that is supported by telecommunications cabling

[SOURCE: EN 50173-1:2011, 3.1.5]

3.1.4

backbone bonding conductor

telecommunications bonding connection which interconnects telecommunications bonding backbones

3.1.5

balanced application

application designed and optimized to operate over symmetric cabling

3.1.6

common bonding network

set of interconnected conductive structures that combine the functions of a protective bonding network and a telecommunications bonding network

3.1.7

equipment bonding conductor

conductor that connects a protective bonding network to an item of telecommunications equipment

3.1.8

main earthing terminal

terminal or busbar which is part of the earthing arrangement of an installation and enabling the electric connection of a number of conductors for earthing purposes

[SOURCE: IEC 60050-826:2004, 826-13-15, modified – The terms “main earthing busbar main”, “grounding terminal (US)” and “main grounding busbar (US)” have been deleted.]

3.1.9

mesh isolated bonding network

mesh bonding network with a single point of connection to either the protective bonding network or another isolated bonding network