

Information technology - Cabling installation - Part 1:
Installation specification and quality assurance

EESTI STANDARDI EESSÕNA

NATIONAL FOREWORD

See Eesti standard EVS-EN 50174-1:2018 sisaldab Euroopa standardi EN 50174-1:2018 ingliskeelset teksti.	This Estonian standard EVS-EN 50174-1:2018 consists of the English text of the European standard EN 50174-1:2018.
Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas.	This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation.
Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 29.06.2018.	Date of Availability of the European standard is 29.06.2018.
Standard on kättesaadav Eesti Standardikeskusest.	The standard is available from the Estonian Centre for Standardisation.

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile standardiosakond@evs.ee.

ICS 35.110

Standardite reprodutseerimise ja levitamise õigus kuulub Eesti Standardikeskusele

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonsesse süsteemi või edastamine ükskõik millises vormis või millisel teel ilma Eesti Standardikeskuse kirjaliku loata on keelatud.

Kui Teil on küsimusi standardite autorikaitse kohta, võtke palun ühendust Eesti Standardikeskusega:
Koduleht www.evs.ee; telefon 605 5050; e-post info@evs.ee

The right to reproduce and distribute standards belongs to the Estonian Centre for Standardisation

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without a written permission from the Estonian Centre for Standardisation.

If you have any questions about copyright, please contact Estonian Centre for Standardisation:

Homepage www.evs.ee; phone +372 605 5050; e-mail info@evs.ee

English Version

**Information technology - Cabling installation - Part 1: Installation
specification and quality assurance**

Technologies de l'information - Installation de câblages -
Partie 1 : Spécification de l'installation et assurance de la
qualité

Informationstechnik - Installation von
Kommunikationsverkabelung - Teil 1:
Installationsspezifikation und Qualitätssicherung

This European Standard was approved by CENELEC on 2018-05-21. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents	Page
European foreword	7
Introduction	8
1 Scope and conformance	10
1.1 Scope.....	10
1.2 Conformance	10
2 Normative references	10
3 Terms, definitions and abbreviations	11
3.1 Terms and definitions	11
3.2 Abbreviations	16
4 Requirements for specifying installations of information technology cabling	16
4.1 Documentation.....	16
4.1.1 General	16
4.1.2 Installation specification.....	17
4.1.3 Technical specification.....	19
4.1.4 Scope of work	25
4.1.5 Quality plan	27
4.1.6 Change control	27
4.2 Planning	27
4.2.1 Power supply/information technology cabling segregation requirements	27
4.2.2 Building entrance facilities (BEF)s.....	27
4.2.3 Pathways	28
4.2.4 Information technology cabling recommendations	30
4.2.5 Cabinets, frames and racks.....	30
4.2.6 Closures.....	31
4.2.7 Termination points	31
4.2.8 Spaces.....	32
4.3 Products and processes	33
4.3.1 General requirements	33
4.3.2 Pathway systems.....	33
4.3.3 Components	34
4.3.4 Labels	34
4.4 External network service provision	35
4.4.1 Requirements	35

4.4.2	Recommendations	35
4.5	Operating procedures	35
4.5.1	General requirements	35
4.5.2	Administration requirements	35
4.5.3	Protection from electrostatic discharge (ESD).....	38
4.6	Maintenance	39
4.6.1	Requirements	39
4.6.2	Recommendations	39
5	Requirements for installers of information technology cabling	40
5.1	Documentation and administration	40
5.1.1	Installation specification requirements.....	40
5.1.2	Quality plan	40
5.1.3	Installation schedule requirements	41
5.1.4	Installation instructions requirements	41
5.1.5	Change control requirements	42
5.1.6	Documentation of the installed cabling.....	42
5.2	Products and processes	42
5.2.1	Compatibility of cabling components	42
5.2.2	Cabling component acceptance	42
5.2.3	Calibration and normalization of inspection and test equipment	43
5.2.4	Pathway systems.....	43
5.2.5	Labelling	43
5.3	Power supplies.....	43
5.4	Surveys	43
5.4.1	Pathways	43
5.4.2	Cabinets, frames and racks	43
5.4.3	Closures	43
6	Installation and operational complexity.....	44
6.1	Requirements.....	44
6.2	Recommendations	44
Annex A (normative)	Minimum requirements for technical specifications and quality plans	45
A.1	General	45
A.2	Technical specification	45
A.3	Quality plan	45
Annex B (normative)	Polarity maintenance: Connecting hardware for multiple optical fibres	46
B.1	General	46

B.2 Duplex connecting hardware interfaces	46
B.2.1 Duplex plugs, adapters and cords	46
B.2.2 Polarity of installed cabling segments	48
B.2.3 The Symmetrical Positioning Method.....	48
B.2.4 The Reverse-Pair Positioning Method	49
Annex C (informative) Polarity maintenance: Connecting hardware interfaces for arrays.....	50
C.1 Connecting hardware interfaces for arrays with 12 optical fibres per row	50
C.1.1 General.....	50
C.1.2 Array connecting hardware components	50
C.1.2.1 General.....	50
C.1.2.2 Cables and array connector patch cords	50
C.1.2.3 Array adapters.....	51
C.1.2.4 Transition assemblies for duplex cabling	51
C.1.3 Array Connectivity Method	52
C.1.3.1 Duplex cabling	52
C.1.3.2 Array cabling	53
C.2 Connecting hardware interfaces for arrays with more than 12 optical fibres per row	54
Annex D (informative) Terminating balanced cables on terminating blocks in distributors	55
D.1 General	55
D.2 The use of the same type of connector at each end of a cable.....	55
D.3 The use of a different type of connector at each end of a cable	55
D.4 Relation between the pins of connectors according to EN 60603-7 and the tags of a terminating block.....	55
Annex E (informative) Compatibility between transmission systems (balanced and unbalanced) sharing the same cable sheath within information technology cabling.....	57
E.1 General	57
E.2 Recommendations concerning cable sharing	57
E.3 Factors to be taken into account to ensure satisfactory performance	57
E.3.1 General	57
E.3.2 Factors concerning the disturbing transmission system.....	58
E.3.3 Cabling characteristics.....	58
E.3.3.1 Crosstalk loss	58
E.3.3.2 Insertion loss.....	58
E.3.3.3 Termination	59

E.3.4	The disturbed transmission system	59
E.4	Guidelines for reducing interference between transmission systems within the same cable sheath	59
E.5	Cabling qualification	59
E.6	Particular installation requirements and recommendations	59
E.7	Cable management	59
E.8	Regulatory aspects	60
Annex F (normative)	Sampling plans and marginal results.....	61
F.1	Sampling plans	61
F.1.1	General	61
F.1.2	Balanced cabling in accordance with the EN 50173 series of standards	61
F.1.3	Optical fibre cabling in accordance with the EN 50173 series of standards	63
F.2	Marginal results	64
F.2.1	Marginal test results	64
F.2.2	Requirements	65
F.2.3	Recommendations	65
F.2.4	Balanced cabling in accordance with the EN 50173 series of standards	65
F.2.5	Optical fibre cabling.....	65
F.3	Non-compliant results	66
Annex G (informative)	“Reaction to fire” performance of cables	67
G.1	EuroClass designation	67
G.2	Application of cables of a given EuroClass designation	67
Bibliography	69

Figures

Figure 1	— Schematic relationship between the EN 50174 series and other relevant standards	9
Figure 2	— Quality assurance schematic	17
Figure 3	— Conductor current for ISO/IEC/IEEE 8802-3 remote powering applications	21
Figure 4	— Examples of labels indicating RP Category of remote powering installation	38
Figure B.1	— Duplex connecting hardware plug	47
Figure B.2	— Duplex connecting adapter	47
Figure B.3	— Duplex patch cord.....	47
Figure B.4	— Views of crossover patch cords	48

Figure B.5 — Optical fibre sequences and adapter orientation in patch panel for the Symmetrical Position Method	49
Figure B.6 — Optical fibre sequences and adapter orientation in patch panel for the Reverse-Pair Position Method	49
Figure C.1 — Array connector cable or patch cord (key-up to key-up)	51
Figure C.2 — Array adapter with aligned keyways	51
Figure C.3 — Transition assembly	52
Figure C.4 — Connectivity method for duplex cabling	53
Figure C.5 — Connectivity method for array cabling	54
Figure F.1 — Schematic of test result boundaries	65

Tables

Table 1 — Contextual relationship between EN 50174 series and other standards relevant for information technology cabling systems	9
Table 2 — Remote powering cabling installation Categories and controls	21
Table 3 — Minimum requirements of administration systems	36
Table 4 — Minimum requirements of operational administration systems	37
Table 5 — Level of installation complexity	44
Table 6 — Level of operational complexity	44
Table A.1 — Minimum requirements for technical specification	45
Table A.2 — Minimum requirements for quality plan	45
Table B.1 — Optical fibre colour code scheme	46
Table D.1 — Examples of the relations between the EN 60603–7 series pins and the tags of the terminating block	56
Table F.1 — Installed balanced cabling test parameters	61
Table F.2 — Installed optical fibre cabling test parameters	64
Table G.1 — EuroClass designations and their foundation standards	68

European foreword

This document (EN 50174-1:2018) has been prepared by Technical Committee CLC/TC 215, "Electrotechnical aspects of telecommunication equipment".

The following dates are fixed:

- latest date by which this document has to be (dop) 2019-05-21
implemented at national level by publication of
an identical national standard or by
endorsement
- latest date by which the national standards (dow) 2021-05-21
conflicting with this document have to be
withdrawn

This document supersedes EN 50174-1:2009, EN 50174-1:2009/A1:2011 and EN 50174-1:2009/A2:2014.

EN 50174 comprises three parts. All three parts support the specification, implementation and operation of information technology cabling. There are specific requirements for cabling systems that are in accordance with the design requirements of the EN 50173 series. However, the three parts also apply to cabling systems of any design including those in accordance with standards such as EN 50700.

This part, EN 50174-1, is concerned with specification, quality assurance, documentation and administration of information technology cabling to be installed, together with its subsequent operation and maintenance. It sets out the responsibilities of information technology cabling installers and premises owners or appointed representatives separately, and is intended to be referenced in relevant contracts.

It does not cover those aspects of installation associated with the transmission of signals in free space between transmitters, receivers or their associated antenna systems (e.g. wireless, radio, microwave or satellite).

This edition of EN 50174-1:

- a) revises the requirements for remote powering to support power levels offered by IEEE 802.3bt (in preparation);
- b) updates various requirements (e.g. in 4.2.5.1 on racks, frames and cabinets and in Table 4 on the level of installation complexity);
- c) revises Annex B on optical fibre connecting hardware, resulting in normative requirements (Annex B) and informative recommendations (Annex C);
- d) introduces a new Annex G with information regarding EuroClasses for the specification of the "reaction to fire" performance of cables.

Introduction

The importance of services delivered by information technology cabling infrastructure is similar to that of utilities such as heating, lighting and electricity supplies. As with those utilities, interruptions to service can have a serious impact. Poor quality of service due to lack of planning, use of inappropriate components, incorrect installation, poor administration or inadequate support can threaten an organization's effectiveness.

There are four phases in the successful implementation of information technology cabling. These are:

- a) design;
- b) specification – the detailed requirement for the cabling, including the planning of its accommodation and associated building services addressing specific environments (e.g. electromagnetic) together with the quality assurance requirements to be applied;
- c) installation – in accordance with the requirements of the specification;
- d) operation – the management of connectivity and the maintenance of transmission performance during the life of the cabling.

This European Standard is in three parts and addresses the specification, installation and operational aspects. The EN 50173 series and other application standards cover design issues.

EN 50174-1 is used during the specification phase. It addresses the:

- installation specification, quality assurance procedures and documentation;
- documentation and administration;
- operation and maintenance.

This part, EN 50174-2 and EN 50174-3 are intended to be used by the personnel directly involved in the planning aspects (of the specification phase) and installation phase. EN 50174-2 is applicable inside buildings and EN 50174-3 is applicable outside buildings.

This European Standard is also relevant to:

- architects, building designers and builders;
- main contractors;
- designers, suppliers, installers, inspectors (auditors), maintainers and owners of information technology cabling;
- public network providers and local service providers;
- end users.

The requirements and recommendations of Clause 4 are primarily for owners of premises housing information technology systems. The owners may delegate selected responsibilities to designers, specifiers, operators and maintainers of installed information technology cabling.

The requirements and recommendations of Clause 5 are primarily for the installers of information technology cabling.

Figure 1 and Table 1 show the schematic and contextual relationships between the standards produced by CLC/TC 215 for information technology cabling, namely:

- 1) this and other parts of the EN 50174 series;

- 2) generic cabling design (EN 50173 series);
- 3) application dependent cabling design (e.g. EN 50700);
- 4) bonding requirements (EN 50310).

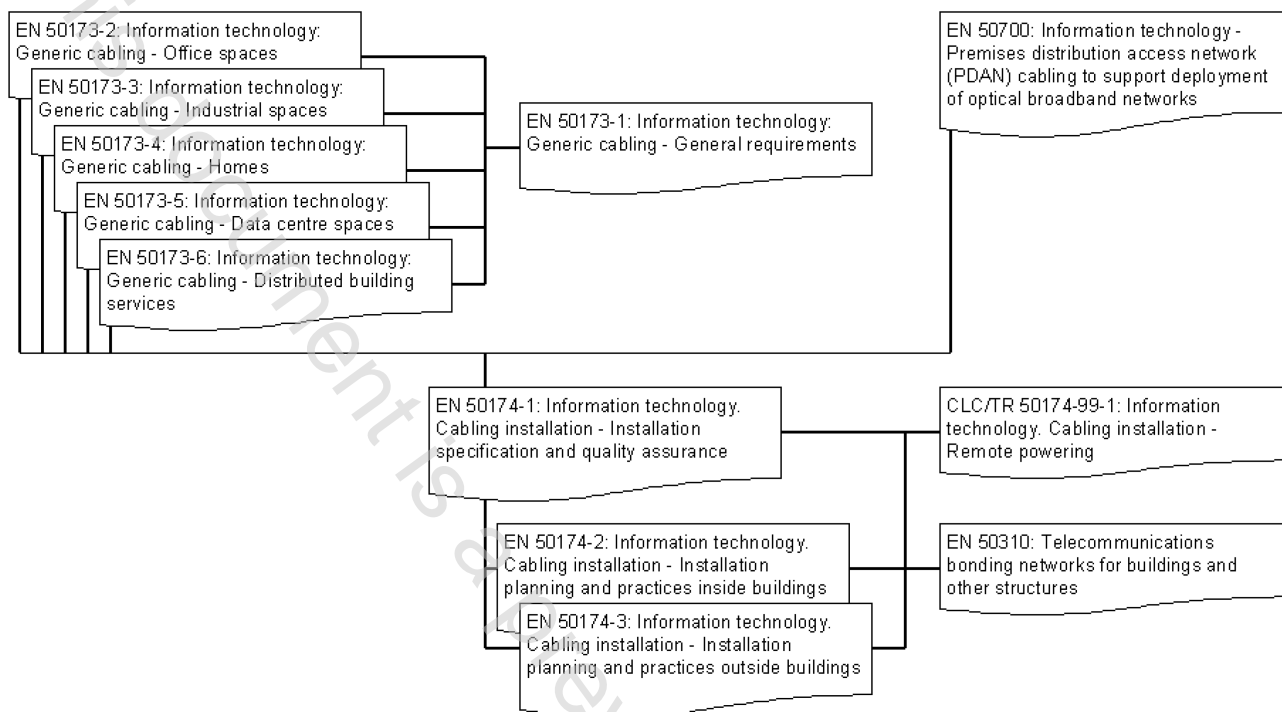


Figure 1 — Schematic relationship between the EN 50174 series and other relevant standards

Table 1 — Contextual relationship between EN 50174 series and other standards relevant for information technology cabling systems

Building design phase	Generic cabling design phase	Specification phase	Installation phase	Operation phase
EN 50310	EN 50173-2	EN 50174-1	EN 50174-2 EN 50174-3 EN 50310	EN 50174-1
	EN 50173-3	Planning phase		
	EN 50173-4 EN 50173-5 EN 50173-6 (these ENs reference general requirements of EN 50173-1)	EN 50174-2 EN 50174-3 EN 50310		

1 Scope and conformance

1.1 Scope

This European Standard specifies requirements for the following aspects of information technology cabling:

- a) installation specification, quality assurance documentation and procedures;
- b) documentation and administration;
- c) operation and maintenance.

This European Standard is applicable to all types of information technology cabling including generic cabling systems designed in accordance with the EN 50173 series.

Safety (electrical safety and protection, optical power, fire, etc.) and electromagnetic compatibility (EMC) requirements are outside the scope of this European Standard and are covered by other standards and regulations. However, information given in this European Standard may be of assistance in meeting these standards and regulations.

1.2 Conformance

For a cabling installation to conform to this European Standard:

- a) the specification of the installation shall meet the requirements of Clause 4;

NOTE The requirements and recommendations of Clause 4 are primarily for owners of premises housing information technology systems. The owners may delegate selected responsibilities to designers, specifiers, operators and maintainers of installed information technology cabling. The party responsible for demonstrating conformance should be clearly stated in the appropriate section of the documentation.

- b) the installer shall meet the requirements of Clause 5;
- c) the bonding system within the premises shall be in accordance with EN 50310;
- d) where a lightning protection system is required, it shall conform to the “integrated lightning protection system” according to EN 62305-4;
- e) other lightning protection systems, including the “isolated lightning protection system” according to EN 62305-3 are allowed provided that specific restrictions are applied both to the implementation of the information technology cabling and the requirements of EN 50310 as agreed between the planners of the lightning protection system and the information technology cabling;
- f) local regulations shall be met.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 13501-6, *Fire classification of construction products and building elements – Part 6: Classification using data from reaction to fire tests on electric cables*

EN 50173-1:2018, *Information technology – Generic cabling systems – Part 1: General requirements*

EN 50173-2, *Information technology – Generic cabling systems – Part 2: Office spaces*

- EN 50173-3, *Information technology – Generic cabling systems – Part 3: Industrial spaces*
- EN 50173-4, *Information technology – Generic cabling systems – Part 4: Homes*
- EN 50173-5, *Information technology – Generic cabling systems – Part 5: Data centre spaces*
- EN 50173-6, *Information technology – Generic cabling systems – Part 6: Distributed building services*
- EN 50174-2, *Information technology – Cabling installation – Part 2: Installation planning and practices inside buildings*
- EN 50174-3, *Information technology – Cabling installation – Part 3: Installation planning and practices outside buildings*
- EN 50310, *Telecommunications bonding networks for buildings and other structures*
- EN 50667, *Information technology – Automated infrastructure management (AIM) systems – Requirements, data exchange and applications*
- EN 60332-1-2, *Tests on electric and optical fibre cables under fire conditions – Part 1-2: Test for vertical flame propagation for a single insulated wire or cable – Procedure for 1 kW pre-mixed flame (IEC 60332-1-2)*
- EN 61935-1, *Specification for the testing of balanced and coaxial information technology cabling – Part 1: Installed balanced cabling as specified in the standards series EN 50173 (IEC 61935-1:2009, modified)*
- EN 62305-4, *Protection against lightning – Part 4: Electrical and electronic systems within structures (IEC 62305-4)*
- EN 62368-3, *Audio/video, information and communication technology equipment – Safety – Part 3: DC power transfer through information technology communication cabling*
- HD 384 (all parts), *Low-voltage electrical installations (IEC 60364 series, modified)*
- HD 60364 (all parts), *Low-voltage electrical installations (IEC 60364 series, modified)*
- ISO/IEC/TR 14763-2-1, *Information technology – Implementation and operation of customer premises cabling – Part 2-1: Planning and installation – Identifiers within administration systems*
- IEC 60050-151:2001, *International Electrotechnical Vocabulary – Chapter 151: Electrical and magnetic devices*
- IEC 60050-161:1990, *International Electrotechnical Vocabulary – Chapter 161: Electromagnetic compatibility*

3 Terms, definitions and abbreviations

3.1 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

Where the cabling is designed in accordance with standards in the EN 50173 series, the additional definitions of those standards are applicable.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>