

INTERNATIONAL ELECTROTECHNICAL COMMISSION
COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

IEC 62271-211
Edition 1.0 2014-04

IEC 62271-211
Édition 1.0 2014-04

**HIGH-VOLTAGE SWITCHGEAR AND
CONTROLGEAR –**

**Part 211: Direct connection between power
transformers and gas-insulated metal-enclosed
switchgear for rated voltages above 52 kV**

APPAREILLAGE À HAUTE TENSION –

**Partie 211: Raccordements directs entre
transformateurs de puissance et appareillage
sous enveloppe métallique à isolation gazeuse
de tensions assignées supérieures à 52 kV**

CORRIGENDUM 1

Corrections to the French version appear after the English text.

Les corrections à la version française sont données après le texte anglais.

Figure 1 – Typical direct connection between power transformer and gas-insulated metal-enclosed switchgear

Replace the existing Figure 1 with the following new figure:


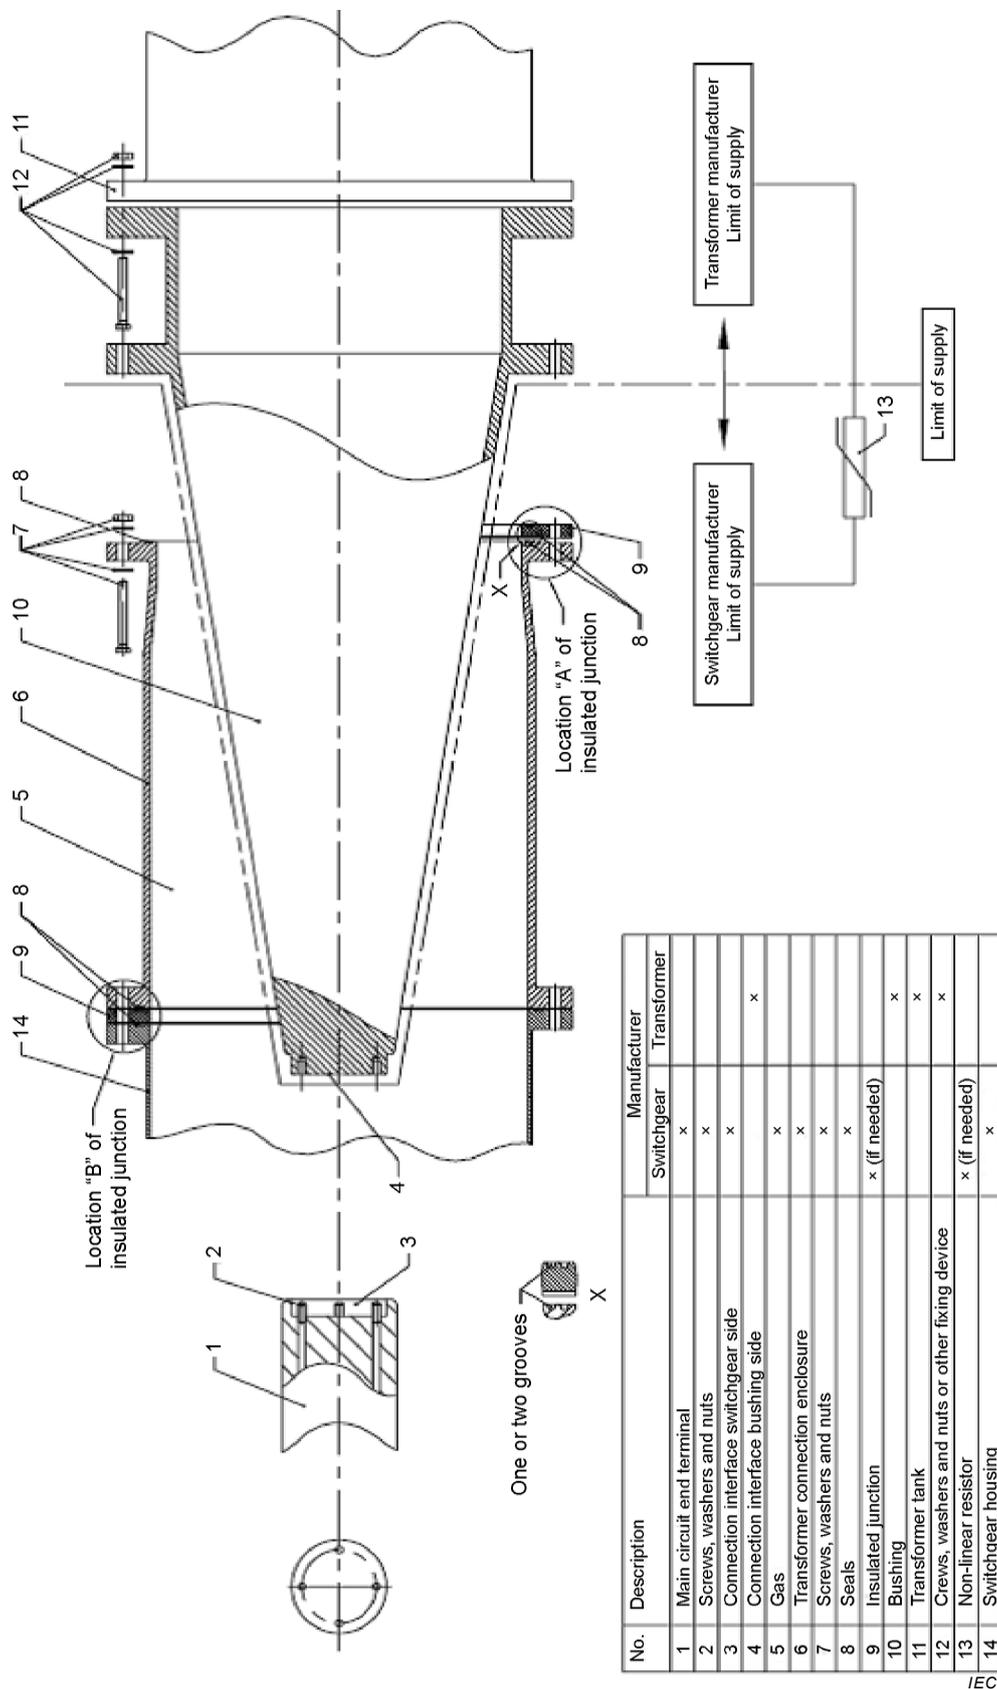


Figure 2 – Standard dimensions for typical direct connection between power transformer and gas-insulated metal-enclosed switchgear

Replace the existing Figure 2 with the following new figure:

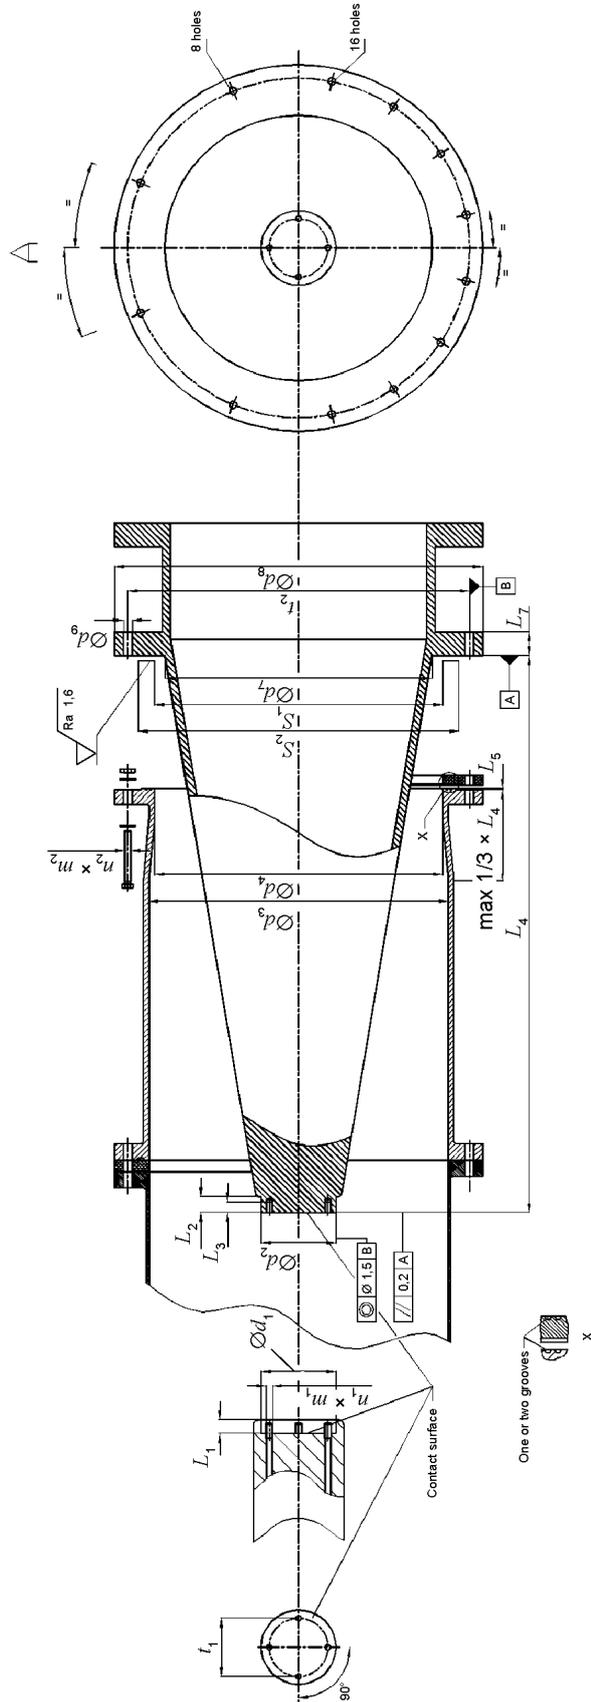

Rated voltage [kV]	Rated lightning impulse withstand voltage [kV]	d_1	d_2	d_3	d_4	d_5	d_6	d_7	d_8	L_1	L_2	L_3	L_4	L_5	L_7	$n_1 \times m_1 / n_2 \times m_2$ (note 1)	S_1 max	S_3 min	$\varnothing t_1$	$\varnothing t_2$
52	325	$^{+0,5}_0$	100	$^{+0,5}_0$	250	200	0	$^{+3}_0$	16	25	30	20	$^{+1}_0$	3	25	4×M12	200	260	70	285
to	to																			
100	450	$^{+0,5}_0$	99	$^{+0,5}_0$	250	200	0	$^{+3}_0$	16	25	30	20	$^{+1}_0$	3	25	4×M12	200	260	70	285
to	to																			
125	550	$^{+0,5}_0$	99	$^{+0,5}_0$	300	220	0	$^{+3}_0$	16	25	30	20	$^{+1}_0$	3	30	4×M12	220	280	70	305
to	to																			
170	750	$^{+0,5}_0$	140	$^{+0,5}_0$	450	450	0	$^{+3}_0$	16	25	30	25	$^{+2}_0$	3	40	4×M12	450	500	110	535
to	to																			
245	850	$^{+0,5}_0$	140	$^{+0,5}_0$	450	450	0	$^{+3}_0$	16	25	30	25	$^{+2}_0$	3	45	4×M12	450	500	110	535
to	to																			
300	1 000	$^{+0,5}_0$	140	$^{+0,5}_0$	540	540	0	$^{+3}_0$	20	25	30	25	$^{+2}_0$	3	45	4×M12	540	600	110	640
to	to																			
362	1 175	$^{+0,5}_0$	140	$^{+0,5}_0$	540	540	0	$^{+3}_0$	20	25	30	25	$^{+2}_0$	3	45	4×M12	540	600	110	640
to	to																			
550	1 550	$^{+0,5}_0$	140	$^{+0,5}_0$	540	540	0	$^{+3}_0$	20	25	30	25	$^{+2}_0$	3	45	4×M12	540	600	110	640

Notes

- The orientation of the fixing holes shall be in accordance with View A
- According to switchgear manufacturer's practice, a recess up to 3 mm may be provided or not