

Ventilation for buildings - Performance testing of components/products for residential ventilation - Part 8: Performance testing of non-ducted mechanical supply and exhaust ventilation units (including heat recovery)

## EESTI STANDARDI EESSÕNA

## NATIONAL FOREWORD

See Eesti standard EVS-EN 13141-8:2022 sisaldab Euroopa standardi EN 13141-8:2022 ingliskeelset teksti.	This Estonian standard EVS-EN 13141-8:2022 consists of the English text of the European standard EN 13141-8:2022.
Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas.	This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation and Accreditation.
Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 07.09.2022.	Date of Availability of the European standard is 07.09.2022.
Standard on kättesaadav Eesti Standardimis-ja Akrediteerimiskeskusest.	The standard is available from the Estonian Centre for Standardisation and Accreditation.

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile [standardiosakond@evs.ee](mailto:standardiosakond@evs.ee).

ICS 91.140.30

Standardite reprodutseerimise ja levitamise õigus kuulub Eesti Standardimis- ja Akrediteerimiskeskusele

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonsesse süsteemi või edastamine ükskõik millises vormis või millisel teel ilma Eesti Standardimis-ja Akrediteerimiskeskuse kirjaliku loata on keelatud.

Kui Teil on küsimusi standardite autorikaitse kohta, võtke palun ühendust Eesti Standardimis-ja Akrediteerimiskeskusega: Koduleht [www.evs.ee](http://www.evs.ee); telefon 605 5050; e-post [info@evs.ee](mailto:info@evs.ee)

The right to reproduce and distribute standards belongs to the Estonian Centre for Standardisation and Accreditation

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without a written permission from the Estonian Centre for Standardisation and Accreditation.

If you have any questions about copyright, please contact Estonian Centre for Standardisation and Accreditation:

Homepage [www.evs.ee](http://www.evs.ee); phone +372 605 5050; e-mail [info@evs.ee](mailto:info@evs.ee)

EUROPEAN STANDARD

EN 13141-8

NORME EUROPÉENNE

EUROPÄISCHE NORM

September 2022

ICS 91.140.30

Supersedes EN 13141-8:2014

English Version

Ventilation for buildings - Performance testing of components/products for residential ventilation - Part 8: Performance testing of non-ducted mechanical supply and exhaust ventilation units (including heat recovery)

Ventilation des bâtiments - Essais de performance des composants/produits pour la ventilation des logements - Partie 8 : Essais de performance des unités de ventilation double flux décentralisées (y compris la récupération de chaleur)

Lüftung von Gebäuden - Leistungsprüfungen von Bauteilen/Produkten für die Lüftung von Wohnungen - Teil 8: Leistungsprüfung von mechanischen Zuluft- und Ablufteinheiten ohne Luftführung (einschließlich Wärmerückgewinnung)

This European Standard was approved by CEN on 10 January 2022.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

<b>Contents</b>	<b>Page</b>
<b>European foreword</b> .....	<b>4</b>
<b>Introduction</b> .....	<b>6</b>
<b>1 Scope</b> .....	<b>8</b>
<b>2 Normative references</b> .....	<b>9</b>
<b>3 Terms and definitions</b> .....	<b>9</b>
<b>4 Symbols and abbreviations</b> .....	<b>14</b>
<b>5 Categories of heat exchangers</b> .....	<b>18</b>
<b>6 Requirements</b> .....	<b>19</b>
<b>7 Test methods</b> .....	<b>20</b>
<b>7.1 General</b> .....	<b>20</b>
<b>7.2 Performance testing of aerodynamic characteristics</b> .....	<b>20</b>
<b>7.2.1 Leakages, mixing and air transfer</b> .....	<b>20</b>
<b>7.2.2 In/out airtightness</b> .....	<b>23</b>
<b>7.2.3 Filter bypass</b> .....	<b>23</b>
<b>7.2.4 Air flow</b> .....	<b>23</b>
<b>7.2.5 Electrical power input</b> .....	<b>26</b>
<b>7.3 Performance testing of thermal characteristics</b> .....	<b>27</b>
<b>7.3.1 General</b> .....	<b>27</b>
<b>7.3.2 Test operating conditions</b> .....	<b>27</b>
<b>7.3.3 Temperature conditions</b> .....	<b>28</b>
<b>7.3.4 Test procedure</b> .....	<b>29</b>
<b>7.3.5 Evaluation on supply air side (mandatory measurement) excluding alternating ventilation units</b> .....	<b>30</b>
<b>7.3.6 Evaluation on exhaust air side (optional measurement) excluding alternating ventilation units</b> .....	<b>31</b>
<b>7.4 Deviating aspects concerning alternating ventilation units</b> .....	<b>31</b>
<b>7.4.1 General</b> .....	<b>31</b>
<b>7.4.2 Internal leakage - Exhaust air transfer ratio</b> .....	<b>31</b>
<b>7.4.3 Determination of air volume flow</b> .....	<b>32</b>
<b>7.4.4 Electrical power input</b> .....	<b>36</b>
<b>7.4.5 Performance testing of thermal characteristics</b> .....	<b>36</b>
<b>8 Classification</b> .....	<b>42</b>
<b>8.1 Leakage classification</b> .....	<b>42</b>
<b>8.2 Air flow sensitivity classification</b> .....	<b>43</b>
<b>8.3 Indoor/outdoor airtightness of the complete unit</b> .....	<b>44</b>
<b>9 Performance testing of acoustic characteristics</b> .....	<b>44</b>
<b>9.1 General</b> .....	<b>44</b>
<b>9.2 Radiative sound power in the indoor or outdoor space</b> .....	<b>44</b>
<b>9.2.1 General</b> .....	<b>44</b>
<b>9.2.2 Reverberant room method</b> .....	<b>45</b>
<b>9.2.3 Anechoic or semi-anechoic room method</b> .....	<b>45</b>
<b>9.2.4 Free field method</b> .....	<b>45</b>
<b>9.3 Airborne sound insulation</b> .....	<b>46</b>

<b>10</b>	<b>Test results</b> .....	<b>47</b>
<b>10.1</b>	<b>Test report</b> .....	<b>47</b>
<b>10.2</b>	<b>Product specifications</b> .....	<b>47</b>
<b>10.3</b>	<b>Additional information related to the performance of the product</b> .....	<b>47</b>
<b>10.4</b>	<b>Leakages</b> .....	<b>47</b>
<b>10.5</b>	<b>Filter bypass</b> .....	<b>48</b>
<b>10.6</b>	<b>Air flow</b> .....	<b>49</b>
<b>10.7</b>	<b>Effective power input</b> .....	<b>49</b>
<b>10.8</b>	<b>Temperature and humidity ratios</b> .....	<b>50</b>
<b>10.9</b>	<b>Acoustic characteristics</b> .....	<b>50</b>
<b>Annex A (normative) Test layouts</b> .....		<b>52</b>
<b>Annex B (normative) Pressure leakage test method</b> .....		<b>55</b>
<b>B.1</b>	<b>General</b> .....	<b>55</b>
<b>B.2</b>	<b>External leakage test</b> .....	<b>55</b>
<b>B.3</b>	<b>Internal leakage test</b> .....	<b>56</b>
<b>Annex C (normative) Indoor mixing</b> .....		<b>57</b>
<b>C.1</b>	<b>General</b> .....	<b>57</b>
<b>C.2</b>	<b>Determination of indoor mixing - First test</b> .....	<b>57</b>
<b>C.3</b>	<b>Determination of indoor mixing - Second test</b> .....	<b>57</b>
<b>C.4</b>	<b>Indoor mixing calculation</b> .....	<b>57</b>
<b>Bibliography</b> .....		<b>58</b>

## European foreword

This document (EN 13141-8:2022) has been prepared by Technical Committee CEN/TC 156 "Ventilation for buildings", the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 2023, and conflicting national standards shall be withdrawn at the latest by March 2023.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 13141-8:2014.

In addition to a number of editorial revisions, the following main changes have been made with respect to EN 13141-8:2014:

- scope has been changed, and concerns now also non-ducted units which ventilate more than one single room;
- terms and definitions as well as symbols and abbreviations have been updated in accordance with the parameters used in the document;
- new categories of heat exchanger have been added;
- designations in 7.2.1.4 and the Formulae (1) to (4) have been changed;
- reference of the internal and external leakage rates has been changes to the reference air volume flow;
- extrapolation of the leakage rates has been added;
- 7.2.1.3.2 concerning exhaust air transfer ratio has been added;
- 7.2.4 concerning air flow measurement has been revised;
- requirements to convert the measured values to standard conditions have been added in 7.2.4 and 7.3.2;
- 7.3.3 has been divided into two separate subclauses 7.3.3.1 for standard tests and 7.3.3.2 for cold climate tests;
- formulae to calculate the temperature ratios have been changed;
- wet bulb temperature for the cold climate test has been changed;
- the order of the specific test for alternating units including storage heat exchanges has been changed;
- deviating aspects for alternating units to determine the air flow correction, thermal performance and the exhaust air transfer ratio have been revised;
- Table 10 concerning the temperature conditions for the cooling performance test has been moved in EN 13142.

A list of all parts in the EN 13141 series, published under the general title *Ventilation for buildings — Performance testing of components/products for residential ventilation* can be found on the CEN website.

Any feedback and questions on this document should be directed to the users' national standards body. A complete listing of these bodies can be found on the CEN website.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.

## Introduction

This document specifies methods for the performance testing of components used in residential ventilation systems to establish the performance characteristics as identified in EN 13142.

This document incorporates many references to other European and International Standards, especially on characteristics other than the aerodynamic characteristics, for instance on acoustic characteristics.

In most cases some additional tests or some additional conditions are given for the specific use in residential ventilation systems.

This document can be used for the following applications:

- laboratory testing;
- attestation purposes.

The position of this document in the field of standards for the mechanical building services is shown in Figure 1.

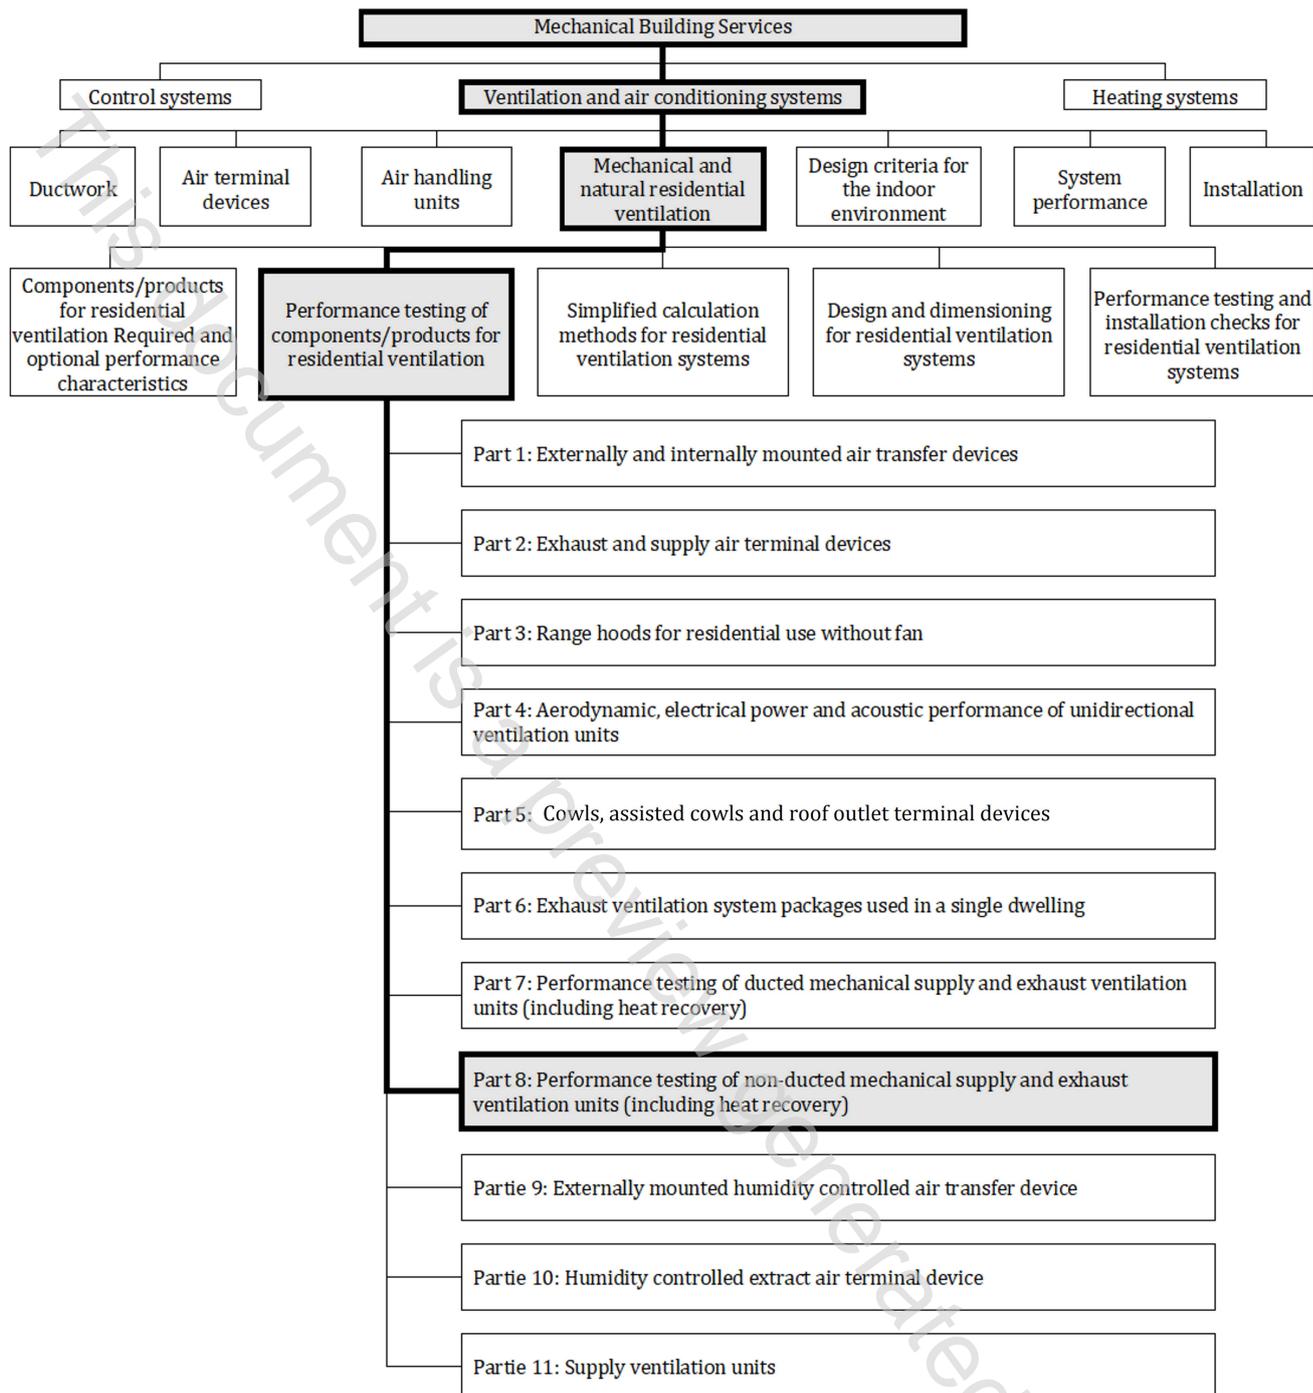


Figure 1 — Position of EN 13141-8 in the field of the mechanical building services

## 1 Scope

This document specifies the laboratory test methods and test requirements for the testing of aerodynamic, thermal, acoustic and the electrical performance characteristics of non-ducted mechanical supply and exhaust residential ventilation units used in single dwellings.

The purpose of this document is not to consider the quality of ventilation but to test the performance of the equipment.

This document is applicable to ventilation units, the latter:

- a) containing either:
  - fans for mechanical supply and exhaust;
  - air filters;
  - air-to-air heat exchanger for heat and possibly humidity recovery;
  - control system;
  - inlet and outlet grilles; or
  - alternating heat exchangers which provide separate supply and exhaust air flows;
- b) provided either:
  - in one assembly; or
  - in more than one assembly, the separate assemblies of which are designed to be used together.

This document does not deal with ducted units which are covered by EN 13141-7 or units with heat pumps.

Safety requirements are given in EN 60335-2-40 and EN 60335-2-80.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 12792:2003, *Ventilation for buildings - Symbols, terminology and graphical symbols*

EN ISO 717-1, *Acoustics - Rating of sound insulation in buildings and of building elements — Part 1: Airborne sound insulation (ISO 717-1)*

EN ISO 5801, *Fans - Performance testing using standardized airways (ISO 5801)*

EN ISO 10140-1, *Acoustics - Laboratory measurement of sound insulation of building elements — Part 1: Application rules for specific products (ISO 10140-1)*

EN ISO 10140-2, *Acoustics - Laboratory measurement of sound insulation of building elements — Part 2: Measurement of airborne sound insulation (ISO 10140-2)*

EN ISO 10140-4, *Acoustics - Laboratory measurement of sound insulation of building elements — Part 4: Measurement procedures and requirements (ISO 10140-4)*

EN ISO 10140-5, *Acoustics - Laboratory measurement of sound insulation of building elements — Part 5: Requirements for test facilities and equipment (ISO 10140-5)*

EN ISO 16890 (all parts), *Air filters for general ventilation (ISO 16890 (all parts))*

ISO 13347-2, *Industrial fans - Determination of fan sound power levels under standardized laboratory conditions - Part 2: Reverberant room method*

ISO 13347-3, *Industrial fans - Determination of fan sound power levels under standardized laboratory conditions - Part 3: Enveloping surface methods*

ISO 13347-4, *Industrial fans - Determination of fan sound power levels under standardized laboratory conditions - Part 4: Sound intensity method*

EN ISO/IEC 17025:2017, *General requirements for the competence of testing and calibration laboratories (ISO/IEC 17025:2017)*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 12792:2003 and the following apply.

ISO and IEC maintain terminological databases for the use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

### 3.1

#### external leakage

$q_{ve}$

leakage to or from the air flowing inside the casing of the ventilation unit to or from the surrounding air

[SOURCE: EN 13141-4:2021, 3.11]