

**Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control**

This document is a preview generated by EVS

## EESTI STANDARDI EESSÕNA

## NATIONAL FOREWORD

See Eesti standard EVS-EN 50600-2-3:2014 sisaldab Euroopa standardi EN 50600-2-3:2014 inglisekeelset teksti.	This Estonian standard EVS-EN 50600-2-3:2014 consists of the English text of the European standard EN 50600-2-3:2014.
Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas.	This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation.
Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 10.10.2014.	Date of Availability of the European standard is 10.10.2014.
Standard on kättesaadav Eesti Standardikeskusest.	The standard is available from the Estonian Centre for Standardisation.

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile [standardiosakond@evs.ee](mailto:standardiosakond@evs.ee).

ICS 35.020, 35.110, 35.160

### **Standardite reprodutseerimise ja levitamise õigus kuulub Eesti Standardikeskusele**

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonsesse süsteemi või edastamine ükskõik millises vormis või millisel teel ilma Eesti Standardikeskuse kirjaliku loata on keelatud.

Kui Teil on küsimusi standardite autorikaitse kohta, võtke palun ühendust Eesti Standardikeskusega:  
Aru 10, 10317 Tallinn, Eesti; [www.evs.ee](http://www.evs.ee); telefon 605 5050; e-post [info@evs.ee](mailto:info@evs.ee)

### **The right to reproduce and distribute standards belongs to the Estonian Centre for Standardisation**

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without a written permission from the Estonian Centre for Standardisation.

If you have any questions about copyright, please contact Estonian Centre for Standardisation:  
Aru 10, 10317 Tallinn, Estonia; [www.evs.ee](http://www.evs.ee); phone 605 5050; e-mail [info@evs.ee](mailto:info@evs.ee)

---

ICS 35.020; 35.110; 35.160

English Version

## Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control

Technologie de l'information - Installation et infrastructures  
des centres de traitement de données - Partie 2-3: Contrôle  
environnemental

Informationstechnik - Einrichtungen und Infrastrukturen von  
Rechenzentren - Teil 2-3: Überwachung der Umgebung

This European Standard was approved by CENELEC on 2014-09-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels**

<b>Contents</b>	<b>Page</b>
<b>Foreword</b> .....	<b>4</b>
<b>Introduction</b> .....	<b>5</b>
<b>1 Scope</b> .....	<b>7</b>
<b>2 Normative references</b> .....	<b>7</b>
<b>3 Terms, definitions and abbreviations</b> .....	<b>7</b>
3.1 Terms and definitions .....	7
3.2 Abbreviations .....	9
<b>4 Conformance</b> .....	<b>9</b>
<b>5 Environmental control within data centres</b> .....	<b>9</b>
5.1 General .....	9
5.2 Environmental control of data centre spaces .....	10
<b>6 Availability</b> .....	<b>14</b>
6.1 General .....	14
6.2 Design options by space.....	14
6.3 Environmental control system capacity planning with respect to expansion.....	18
6.4 Environmental control system capacity planning with respect to resilience .....	18
<b>7 Physical security</b> .....	<b>18</b>
7.1 General .....	18
7.2 Access .....	18
<b>8 Energy efficiency enablement</b> .....	<b>18</b>
8.1 General .....	18
8.2 Measurement of temperature .....	19
8.3 Measurement of relative humidity.....	20
8.4 Measurement of air pressure.....	21
8.5 Coolant flow rates .....	21
8.6 Heat removal .....	21
8.7 Outside air.....	22
8.8 Provision of alarms .....	22
8.9 Measurement requirements by Granularity Level.....	22
<b>Annex A (normative) Distribution methodologies for temperature-controlled air in computer room space</b> .....	<b>23</b>
<b>A.1 Cabinet or rack air flow management</b> .....	<b>23</b>
<b>A.2 Access floor air flow management</b> .....	<b>23</b>
<b>A.3 Hot aisles/cold aisles</b> .....	<b>24</b>
<b>Annex B (informative) Control system concepts</b> .....	<b>26</b>
<b>B.1 General</b> .....	<b>26</b>
<b>B.2 Control of exhaust temperature (return air)</b> .....	<b>26</b>
<b>B.3 Control of supply temperature (supply air)</b> .....	<b>26</b>

<b>B.4</b>	<b>Combination of control of supply and exhaust temperature .....</b>	<b>26</b>
<b>B.5</b>	<b>Supply air relative humidity .....</b>	<b>26</b>
<b>B.6</b>	<b>Proportion of outside air .....</b>	<b>26</b>
	<b>Bibliography.....</b>	<b>27</b>

This document is a preview generated by EVS

## Foreword

This document (EN 50600-2-3:2014) has been prepared by CLC/TC 215 “Electrotechnical aspects of telecommunication equipment”.

The following dates are fixed:

- latest date by which this document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2015-09-01
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) 2017-09-01

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CENELEC by the European Commission and the European Free Trade Association.

This document is a preview generated by EVS

## Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres need to provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of carbon footprint) and with respect to economical considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control and physical security. Effective management and operational information is required to monitor achievement of the defined needs and objectives.

This series of European Standards specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:


- 1) owners, facility managers, ICT managers, project managers, main contractors;
- 2) architects, building designers and builders, system and installation designers;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

At the time of publication of this European Standard, the EN 50600 series will comprise the following standards:

- EN 50600-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*;
- EN 50600-2-1, *Information technology — Data centre facilities and infrastructures — Part 2-1: Building construction*;
- EN 50600-2-2, *Information technology — Data centre facilities and infrastructures — Part 2-2: Power distribution*;
- EN 50600-2-3, *Information technology — Data centre facilities and infrastructures — Part 2-3: Environmental control*;

- EN 50600-2-4, *Information technology — Data centre facilities and infrastructures — Part 2-4: Telecommunications cabling infrastructure*;
- EN 50600-2-5, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems*;
- EN 50600-2-6, *Information technology — Data centre facilities and infrastructures — Part 2-6: Management and operational information*.

The inter-relationship of the standards within the EN 50600 series is shown in Figure 1.

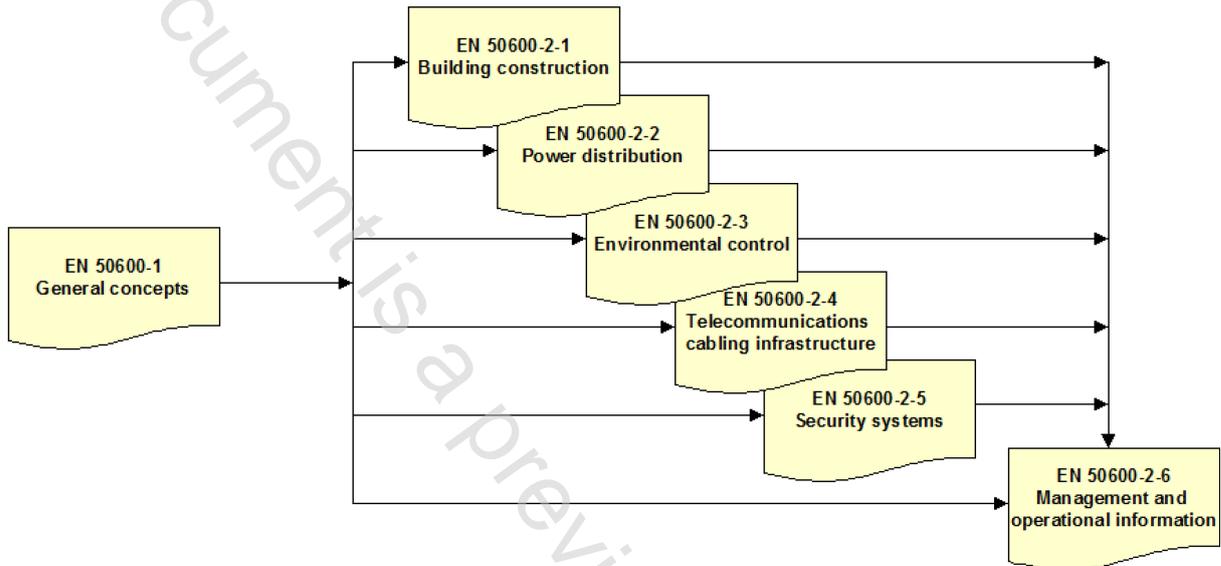

**Figure 1 — Schematic relationship between the EN 50600 standards**

EN 50600-2-X standards specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from EN 50600-1.

This European Standard addresses the environmental control facilities and infrastructure within data centres together with the interfaces for monitoring the performance of those facilities and infrastructures in line with EN 50600-2-6 (in accordance with the requirements of EN 50600-1).

This series of European Standards does not address the selection of information technology and network telecommunications equipment, software and associated configuration issues.

## 1 Scope

This European Standard addresses environmental control within data centres based upon the criteria and classifications for “availability”, “security” and “energy efficiency enablement” within EN 50600-1.

This European Standard specifies requirements and recommendations for the following:

- a) temperature control,
- b) fluid movement control,
- c) relative humidity control,
- d) particulate control,
- e) vibration,
- f) floor layout and equipment locations,
- g) energy saving practices,
- h) physical security of environmental control systems.

For issues related to electromagnetic environment, see EN 50600-2-5.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50600-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*

EN 50600-2-5<sup>1)</sup>, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems*

## 3 Terms, definitions and abbreviations

### 3.1 Terms and definitions

For the purposes of this document, the terms and definitions in EN 50600-1 and the following apply.

#### 3.1.1

##### **adiabatic cooling**

adiabatic cooling is a cooling system that is using the evaporative cooling principle to reduce the air temperature

#### 3.1.2

##### **absolute humidity**

quantity of water vapour in a given volume of air, expressed by mass

---

1) Circulated for CENELEC enquiry.