
ICS 29.130.20

English Version

**Low-voltage switchgear and controlgear assemblies - Part 5:
Assemblies for power distribution in public networks
(IEC 61439-5:2023/COR1:2025)**

Ensembles d'appareillage à basse tension - Partie 5:
Ensembles pour réseaux de distribution publique
(IEC 61439-5:2023/COR1:2025)

Niederspannungs-Schaltgerätekombinationen - Teil 5:
Schaltgerätekombinationen in öffentlichen
Energieverteilungsnetzen
(IEC 61439-5:2023/COR1:2025)

This corrigendum becomes effective on 28 February 2025 for incorporation in the English language version of the EN.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Endorsement notice

The text of the corrigendum IEC 61439-5:2023/COR1:2025 was approved by CENELEC as EN IEC 61439-5:2023/AC:2025-02 without any modification.

INTERNATIONAL ELECTROTECHNICAL COMMISSION
COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

IEC 61439-5
Edition 3.0 2023-05

**LOW-VOLTAGE SWITCHGEAR AND
CONTROLGEAR ASSEMBLIES –**

**Part 5: Assemblies for power distribution in
public networks**

IEC 61439-5
Édition 3.0 2023-05

**ENSEMBLES D'APPAREILLAGE A BASSE
TENSION –**

**Partie 5: Ensembles pour réseaux de
distribution publique**

C O R R I G E N D U M 1

10.2 Strength of materials and parts

**10.2.101.6 Verification of mechanical
strength of doors**

*Add at the end of second paragraph the
following sentence:*

Doors designed to be unhinged without
the use of a tool for maintenance or
operation use shall be tested as above
described but only with 50 N.

**10.2 Résistance des matériaux et des
parties**


**10.2.101.6 Vérification de la
résistance mécanique des
portes**

*Ajouter la phrase suivante à la fin du
deuxième alinéa:*

Les portes conçues pour être dégondées
sans utiliser d'outil à des fins de
maintenance ou pour leur utilisation
doivent être soumises à essai comme
décrit ci-dessus mais avec une force de
50 N seulement.


Replace Figure 107 with the following:

Remplacer la Figure 107 par la suivante:

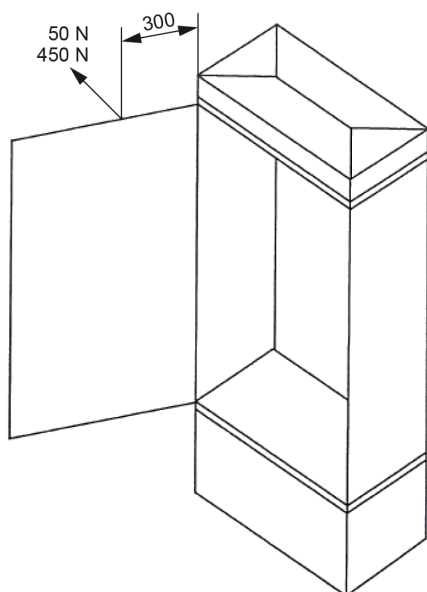

IEC

Figure 107 – Diagram of test to verify the mechanical strength of doors

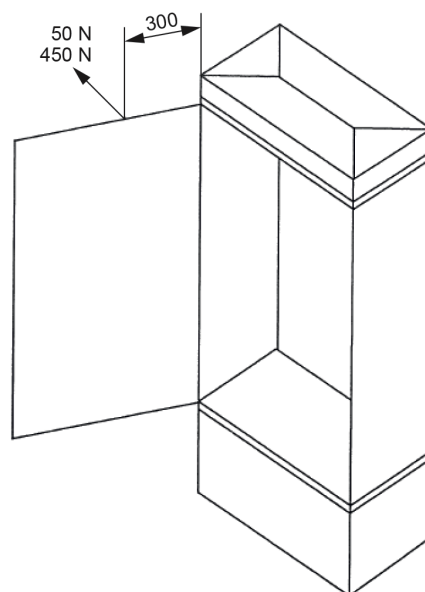

IEC

Figure 107 – Schéma de l'essai de vérification de la tenue mécanique des portes