

Piping systems for rehabilitation of underground drains, sewers and water supply networks - Part 1: Polyethylene (PE) material (ISO 11300-1:2026)

## EESTI STANDARDI EESSÕNA

## NATIONAL FOREWORD

<p>See Eesti standard EVS-EN ISO 11300-1:2026 sisaldab Euroopa standardi EN ISO 11300-1:2026 ingliskeelset teksti.</p> <p>Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas.</p> <p>Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 11.02.2026.</p> <p>Standard on kättesaadav Eesti Standardimis- ja Akrediteerimiskeskusest.</p>	<p>This Estonian standard EVS-EN ISO 11300-1:2026 consists of the English text of the European standard EN ISO 11300-1:2026.</p> <p>This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation and Accreditation.</p> <p>Date of Availability of the European standard is 11.02.2026.</p> <p>The standard is available from the Estonian Centre for Standardisation and Accreditation.</p>
--	---

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile [standardiosakond@evs.ee](mailto:standardiosakond@evs.ee).

ICS 23.040.20

<p>Standardite ja standardilaadsete dokumentide reprodutseerimise ja levitamise õigus kuulub Eesti Standardimis- ja Akrediteerimiskeskusele</p> <p>Eesti standardid ja standardilaadsed dokumendid on Eesti Standardimis- ja Akrediteerimiskeskuse intellektuaalomand ning neid kasutatakse litsentsi alusel dokumentide kasutuslepingu tingimuste kohaselt.</p> <p>Ilma Eesti Standardimis- ja Akrediteerimiskeskuse eelneva kirjaliku loata on keelatud standardite ja standardilaadsete dokumentide täielik või osaline reprodutseerimine, levitamine, muutmine või kasutamine mis tahes kujul ja viisil - sealhulgas kopeerimine, skaneerimine, salvestamine või jagamine teel digiplatvormidel (k.a masinõppe ja tehisintellekti rakendustes). Loata kasutamine väljaspool litsentsi tingimusi käsitletakse õigusrikkumisenä.</p> <p>Kui Teil on küsimusi standardite ja standardilaadsete dokumentide autoriõiguse kaitse kohta, võtke palun ühendust Eesti Standardimis- ja Akrediteerimiskeskusega: Veebileht <a href="http://www.evs.ee">www.evs.ee</a>; telefon +372 6055050; e-post <a href="mailto:info@evs.ee">info@evs.ee</a></p> <p>The right to reproduce and distribute standards and standard-like documents belongs to the Estonian Centre for Standardisation and Accreditation</p> <p>Estonian standards and standard-like documents are the intellectual property of the Estonian Centre for Standardisation and Accreditation and are made available under license in accordance with the terms and conditions of the document use agreement.</p> <p>Without the prior written permission of the Estonian Centre for Standardisation and Accreditation, the full or partial reproduction, distribution, modification, or use of standards and standard-like documents in any form or by any means - including photocopying, scanning, storing, or sharing via digital platforms (incl. in machine learning and artificial intelligence applications) - is strictly prohibited. Any unauthorized use beyond the scope of the granted license is prohibited and may result in legal action.</p> <p>If you have any questions about copyright, please contact Estonian Centre for Standardisation and Accreditation: Homepage <a href="http://www.evs.ee">www.evs.ee</a>; phone +372 605 5050; e-mail <a href="mailto:info@evs.ee">info@evs.ee</a></p>
--

EUROPEAN STANDARD

EN ISO 11300-1

NORME EUROPÉENNE

EUROPÄISCHE NORM

February 2026

ICS 23.040.20

Supersedes EN ISO 11296-2:2018, EN ISO 11297-2:2018, EN ISO 11298-2:2018, EN ISO 11296-1:2018, EN ISO 11296-3:2018, EN ISO 11297-1:2018, EN ISO 11297-3:2018, EN ISO 11298-1:2018, EN ISO 11298-3:2018

English Version

Piping systems for rehabilitation of underground drains, sewers and water supply networks - Part 1: Polyethylene (PE) material (ISO 11300-1:2026)

Systèmes de canalisations pour la réhabilitation des branchements, des collecteurs d'assainissement et des réseaux d'alimentation en eau enterrés - Partie 1: Matériau polyéthylène (PE) (ISO 11300-1:2026)

Rohrleitungssysteme für die Sanierung von unterirdischen Entwässerungs-, Kanalisations- und Wasserversorgungsnetzen - Teil 1: Werkstoff Polyethylen (PE) (ISO 11300-1:2026)

This European Standard was approved by CEN on 1 February 2026.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

## European foreword

This document (EN ISO 11300-1:2026) has been prepared by Technical Committee ISO/TC 138 "Plastics pipes, fittings and valves for the transport of fluids" in collaboration with Technical Committee CEN/TC 155 "Plastics piping systems and ducting systems" the secretariat of which is held by NEN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by August 2026, and conflicting national standards shall be withdrawn at the latest by August 2026.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN ISO 11296-2:2018, EN ISO 11297-2:2018, EN ISO 11298-2:2018, EN ISO 11296-1:2018, EN ISO 11296-3:2018, EN ISO 11297-1:2018, EN ISO 11297-3:2018, EN ISO 11298-1:2018, EN ISO 11298-3:2018, EN ISO 21225-1:2018 and EN ISO 21225-2:2018.

Any feedback and questions on this document should be directed to the users' national standards body/national committee. A complete listing of these bodies can be found on the CEN website.

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.

## Endorsement notice

The text of ISO 11300-1:2026 has been approved by CEN as EN ISO 11300-1:2026 without any modification.



**International  
Standard**

**ISO 11300-1**

**Piping systems for rehabilitation  
of underground drains, sewers and  
water supply networks —**

**Part 1:  
Polyethylene (PE) material**

*Systemes de canalisations pour la réhabilitation des  
branchements, des collecteurs d'assainissement et des réseaux  
d'alimentation en eau enterrés —*

*Partie 1: Matériau polyéthylène (PE)*

**First edition  
2026-02**

This document is a preview generated by EVS



## **COPYRIGHT PROTECTED DOCUMENT**

© ISO 2026

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
CP 401 • Ch. de Blandonnet 8  
CH-1214 Vernier, Geneva  
Phone: +41 22 749 01 11  
Email: [copyright@iso.org](mailto:copyright@iso.org)  
Website: [www.iso.org](http://www.iso.org)

Published in Switzerland

# Contents

	Page
<b>Foreword</b> .....	<b>v</b>
<b>Introduction</b> .....	<b>vi</b>
<b>1 Scope</b> .....	<b>1</b>
<b>2 Normative references</b> .....	<b>2</b>
<b>3 Terms and definitions</b> .....	<b>3</b>
3.1 General.....	3
3.2 Terms related to techniques.....	4
3.3 Terms related to characteristics.....	4
3.4 Terms related to product stages.....	6
3.5 Terms related to materials.....	6
3.6 Terms related to service conditions.....	7
3.7 Terms related to joints.....	8
<b>4 Symbols and abbreviated terms</b> .....	<b>9</b>
4.1 Symbols.....	9
4.2 Abbreviated terms.....	10
<b>5 Pipes</b> .....	<b>10</b>
5.1 Materials.....	10
5.1.1 General.....	10
5.1.2 Virgin material.....	10
5.1.3 Reprocessable material and recyclable material.....	11
5.2 General characteristics.....	11
5.2.1 Appearance.....	11
5.2.2 Colour.....	11
5.3 Material characteristics.....	11
5.4 Geometric characteristics.....	11
5.5 Mechanical characteristics.....	11
5.6 Physical characteristics.....	12
5.7 Jointing.....	12
5.8 Marking.....	12
5.9 Regional requirements for pipes.....	13
<b>6 Fittings</b> .....	<b>13</b>
6.1 Materials.....	13
6.2 General characteristics.....	13
6.3 Material characteristics.....	14
6.4 Geometric characteristics.....	14
6.5 Mechanical characteristics.....	14
6.6 Physical characteristics.....	14
6.7 Jointing.....	14
6.8 Marking.....	14
6.9 Regional requirements for fittings.....	14
<b>7 Ancillary components</b> .....	<b>14</b>
<b>8 Fitness for purpose</b> .....	<b>15</b>
8.1 Materials.....	15
8.2 General characteristics.....	15
8.3 Geometric characteristics.....	15
8.4 Mechanical characteristics.....	15
8.5 Sampling.....	16
8.6 Regional requirements for pipes.....	16
<b>9 Installation practice</b> .....	<b>16</b>
9.1 Preparatory work.....	16
9.2 Storage, handling and transport of pipes and fittings.....	17

9.3	Equipment.....	17
9.3.1	General.....	17
9.3.2	Butt fusion equipment and de-beading equipment.....	17
9.3.3	Pipe skids/rollers.....	18
9.3.4	Winching and rod-pulling equipment.....	18
9.3.5	Pipe entry guides.....	18
9.3.6	Electrofusion equipment.....	18
9.3.7	Inspection equipment.....	18
9.3.8	Lifting equipment.....	19
9.4	Installation.....	19
9.4.1	General.....	19
9.4.2	Safety precautions.....	20
9.4.3	Simulated installations.....	20
9.5	Process-related inspection and testing.....	20
9.6	Pipe end termination.....	21
9.7	Reconnection to the existing pipeline system.....	21
9.8	Final inspection and testing.....	21
9.9	Documentation.....	21
<b>Annex A (normative) Additional requirements applicable for lining with continuous pipes.....</b>		<b>22</b>
<b>Annex B (normative) Additional requirements applicable for lining with close-fit pipes.....</b>		<b>24</b>
<b>Annex C (normative) Additional requirements for trenchless replacement techniques — Pipe bursting, pipe extraction, horizontal directional drilling and impact moling.....</b>		<b>29</b>
<b>Annex D (normative) Layered pipes.....</b>		<b>34</b>
<b>Annex E (normative) Factory-folded heat-reverted polyethylene (PE) pipe — Determination of memory ability.....</b>		<b>35</b>
<b>Annex F (informative) Pipe design considerations specific to pipe bursting and pipe extraction.....</b>		<b>37</b>
<b>Annex G (informative) Pipe design considerations specific to HDD.....</b>		<b>39</b>
<b>Annex H (informative) Summary of required elements to be included in installation manuals.....</b>		<b>41</b>
<b>Bibliography.....</b>		<b>43</b>

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

ISO draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). ISO takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, ISO had not received notice of (a) patent(s) which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at [www.iso.org/patents](http://www.iso.org/patents). ISO shall not be held responsible for identifying any or all such patent rights.

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see [www.iso.org/iso/foreword.html](http://www.iso.org/iso/foreword.html).

This document was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 8, *Rehabilitation of pipeline systems*, in collaboration with the European Committee for Standardization (CEN) Technical Committee CEN/TC 155, *Plastics piping systems and ducting systems*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This first edition of ISO 11300-1, together with ISO 11300-2, ISO 11300-3, ISO/DIS 11300-4 (in preparation) and ISO 11301-1, cancels and replaces ISO 11296-1:2018, ISO 11296-2:2018, ISO 11296-3:2018, ISO 11297-1:2018, ISO 11297-2:2018, ISO 11297-3:2018, ISO 11298-1:2018, ISO 11298-2:2018, ISO 11298-3:2018, ISO 21225-1:2018 and ISO 21225-2:2018, which have been technically revised.

The main changes are as follows:

- for piping systems made from polyethylene (PE) material, this document replaces the related content, including requirements, of the documents listed above.

A list of all parts in the ISO 11300 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at [www.iso.org/members.html](http://www.iso.org/members.html).

## Introduction

This document is a part of a series of International Standards concerning piping systems of various materials used for the rehabilitation of existing pipelines in a specified application area:

- ISO 11300 series: Piping systems for rehabilitation of underground drains, sewers and water supply networks;
- ISO 11301 series: Piping systems for rehabilitation of underground gas supply networks.

The ISO 11300 series and the ISO 11301 series are subdivided into parts covering a specific material per piping system.

The ISO 11300 series is subdivided in four parts:

- *Part 1: Polyethylene (PE) material (this document);*
- *Part 2: Thermoset composite materials;*
- *Part 3: PVC-U material;*
- *Part 4: Thermoplastic composite materials.*


These documents cover various techniques for renovation and trenchless replacement. Furthermore, they are distinguished from those for conventionally installed plastics piping systems by the requirement to verify certain characteristics in the “as-installed” condition, after site processing. This is in addition to specifying requirements for piping system components “as manufactured”.

A consistent structure of clause headings has been adopted for all parts of the ISO 11300 series and the ISO 11301 series, in order to facilitate direct comparisons across renovation technique families.

[Figure 1](#) shows the clause structure and the relationship between the ISO 11300 series and the ISO 11301 series.

For complementary information, see ISO 11295.


For assessment of conformity to the requirements of this document, see ISO/TS 23818-1<sup>[3]</sup>.

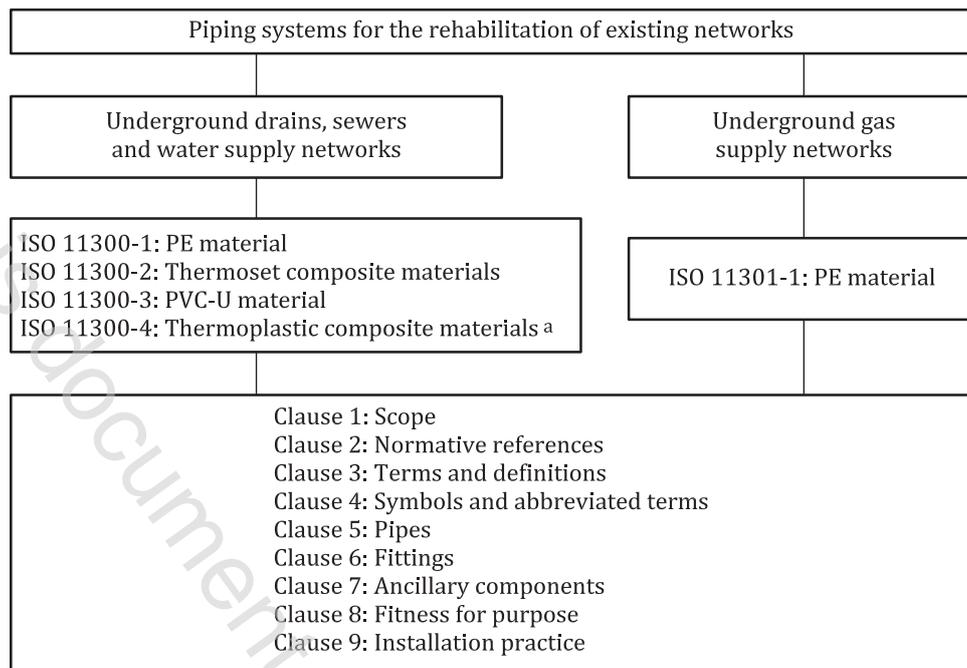

<sup>a</sup> In preparation.

**Figure 1 — Clause structure of the ISO 11300 series and the ISO 11301 series**

The various techniques for rehabilitation of underground drains, sewers and water supply networks, within the scope of pipeline rehabilitation techniques generally, are shown schematically in [Figure 2](#). For definitions of standardized renovation techniques shown in [Figure 2](#), but outside the scope of this document, see ISO 11295.

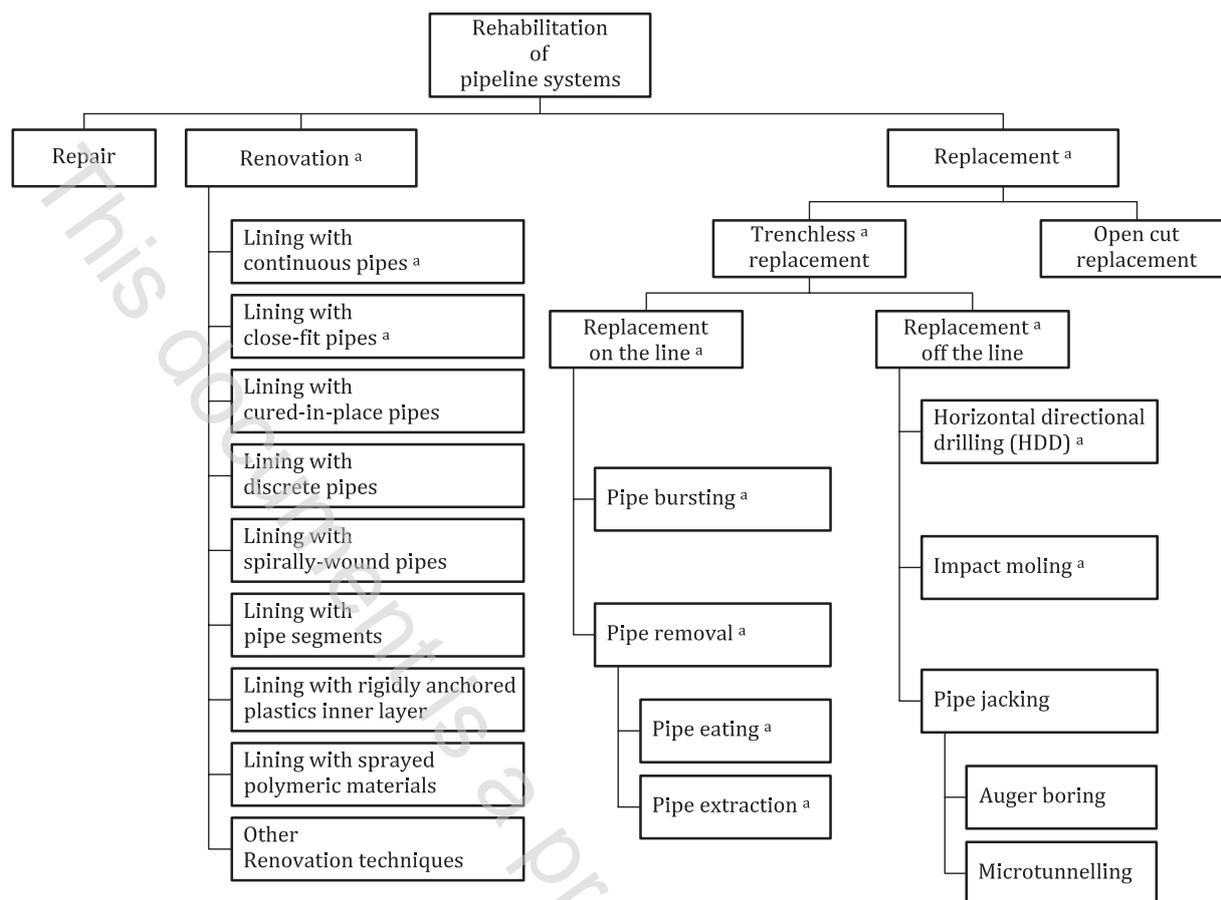

<sup>a</sup> This document is applicable, for piping systems made from PE materials.

**Figure 2 — Technique families for rehabilitation of underground drains, sewers and water supply networks using plastics pipes, within the scope of pipeline rehabilitation techniques**

# Piping systems for rehabilitation of underground drains, sewers and water supply networks —

## Part 1: Polyethylene (PE) material

### 1 Scope

This document specifies requirements and test methods for pipes and fittings which are part of piping systems for the rehabilitation, by means of renovation and trenchless replacement, of underground non-pressure and pressure drains and sewers and water supply networks, which transport water intended for human consumption, including raw water pipelines.

It is applicable to polyethylene (PE) pipes, fittings and assemblies, as manufactured and as installed. It is not applicable to the existing pipeline.

It is applicable to the following technique families for renovation, intended to be used at an operating temperature of 20 °C as the reference temperature:

- lining with continuous pipes;
- lining with close-fit pipes.

This document is applicable to the following technique families for trenchless replacement, intended to be used at an operating temperature of 20 °C as the reference temperature:

- pipe bursting and pipe extraction;
- horizontal directional drilling and impact moling.

NOTE For applications operating at constant temperatures greater than 20 °C and up to 40 °C, see ISO 4427-1:2019, Annex A.

When used with lining with continuous pipes, lining with close-fit pipes and trenchless replacement technique families, this document is applicable to:

- PE solid wall single layered pipes (nominal outside diameter,  $d_n$ ), including any identification stripes;
- PE pipes with co-extruded layers on either or both the outside and inside of the pipe (total outside diameter,  $d_n$ ), as specified in [Annex D](#), where all layers have the same MRS rating.

Furthermore, when used with lining with continuous pipes and trenchless replacement this document is applicable to:

- PE coated pipes (outside diameter,  $d_n$ ) having a peelable, contiguous, thermoplastics additional layer on the outside of the pipe (“coated pipe”), as specified in [Annex D](#).

This document is applicable to jointing by means of butt fusion and electrofusion and to fabricated and injection-moulded fittings and mechanical connections of PE.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 1167-1, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 1: General method*

ISO 1167-2, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 2: Preparation of pipe test pieces*

ISO 2505, *Thermoplastics pipes — Longitudinal reversion — Test method and parameters*

ISO 3126, *Plastics piping systems — Plastics components — Determination of dimensions*

ISO 4427-1:2019, *Plastics piping systems for water supply and for drainage and sewerage under pressure — Polyethylene (PE) — Part 1: General*

ISO 4427-2, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 2: Pipes*

ISO 4427-3, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 3: Fittings*

ISO 4427-5, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

ISO 4633, *Rubber seals — Joint rings for water supply, drainage and sewerage pipelines — Specification for materials*

ISO 8772, *Plastics piping systems for non-pressure underground drainage and sewerage — Polyethylene (PE)*

ISO 9967, *Thermoplastics pipes — Determination of creep ratio*

ISO 9969, *Thermoplastics pipes — Determination of ring stiffness*

ISO 11295, *Plastics piping systems used for the rehabilitation of pipelines — Classification and overview of strategic, tactical and operational activities*

ISO 12176-1, *Plastics pipes and fittings — Equipment for fusion jointing polyethylene systems — Part 1: Butt fusion*

ISO 12176-2, *Plastics pipes and fittings — Equipment for fusion jointing polyethylene systems — Part 2: Electrofusion*

EN 681-1, *Elastomeric seal — Material requirements for pipe joint seals used in water and drainage applications — Part 1: Vulcanized rubber*

EN 681-2, *Elastomeric seals — Material requirements for pipe joint seals used in water and drainage applications — Part 2: Thermoplastic elastomers*

EN 681-3, *Elastomeric seals — Material requirements for pipe joint seals used in water and drainage applications — Part 3: Cellular materials of vulcanized rubber*

EN 681-4, *Elastomeric seals — Material requirements for pipe joint seals used in water and drainage applications — Part 4: Cast polyurethane sealing elements*

EN 12201-1, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 1: General*

EN 12201-2, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 2: Pipes*

EN 12201-3, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 3: Fittings*

EN 12201-5, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

EN 12666-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Polyethylene (PE) — Part 1: Specifications for pipes, fittings and the system*

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 11295 and the following apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

#### 3.1 General

##### 3.1.1

##### **characteristic**

property, dimension or other feature of a material or component

##### 3.1.2

##### **declared value**

limiting value of a *characteristic* (3.1.1) declared in advance by the *rehabilitation systemsupplier* (3.1.5), which becomes the requirement for the purposes of assessment of conformity

##### 3.1.3

##### **coated pipe**

pipe with a peelable, contiguous thermoplastic additional layer on the outside of the pipe

##### 3.1.4

##### **solid wall single layered pipe**

pipe with smooth internal and external surface, extruded from the same compound throughout the wall

##### 3.1.5

##### **rehabilitation system supplier**

entity that specifies the field and range of application and brings together the components of a rehabilitation system to meet the requirements of the product standard at the “*M*” stage (3.4.1), so that when installed in accordance with the installation manual they meet the requirements of the product standard at the “*I*” stage (3.4.2)

##### 3.1.6

##### **system installer**

entity that prepares the host pipe, takes the rehabilitation system at the “*M*” stage (3.4.1) and installs it so that it is at the “*I*” stage (3.4.2)

##### 3.1.7

##### **type testing**

testing performed to prove that a material, component, joint or assembly is capable of conforming to the requirements given in the applicable standard