

Smoke and heat control systems - Part 7: Smoke duct sections

This document is a preview generated by EVS

EESTI STANDARDI EESSÕNA

NATIONAL FOREWORD

Käesolev Eesti standard EVS-EN 12101-7:2011 sisaldab Euroopa standardi EN 12101-7:2011 ingliskeelset teksti.

Standard on kinnitatud Eesti Standardikeskuse 31.05.2011 käskkirjaga ja jõustub sellekohase teate avaldamisel EVS Teatajas.

Euroopa standardimisorganisatsioonide poolt rahvuslikele liikmetele Euroopa standardi teksti kättesaadavaks tegemise kuupäev on 04.05.2011.

Standard on kättesaadav Eesti standardiorganisatsioonist.

This Estonian standard EVS-EN 12101-7:2011 consists of the English text of the European standard EN 12101-7:2011.

This standard is ratified with the order of Estonian Centre for Standardisation dated 31.05.2011 and is endorsed with the notification published in the official bulletin of the Estonian national standardisation organisation.

Date of Availability of the European standard text 04.05.2011.

The standard is available from Estonian standardisation organisation.

ICS 97.120

Standardite reprodutseerimis- ja levitamiseõigus kuulub Eesti Standardikeskusele

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonilisse süsteemi või edastamine ükskõik millises vormis või millisel teel on keelatud ilma Eesti Standardikeskuse poolt antud kirjaliku loata.

Kui Teil on küsimusi standardite autorikaitse kohta, palun võtke ühendust Eesti Standardikeskusega:
Aru 10 Tallinn 10317 Eesti; www.evs.ee; Telefon: 605 5050; E-post: info@evs.ee

Right to reproduce and distribute belongs to the Estonian Centre for Standardisation

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without permission in writing from Estonian Centre for Standardisation.

If you have any questions about standards copyright, please contact Estonian Centre for Standardisation:
Aru str 10 Tallinn 10317 Estonia; www.evs.ee; Phone: 605 5050; E-mail: info@evs.ee

ICS

English Version

Smoke and heat control systems - Part 7: Smoke duct sections

Systèmes pour le contrôle des fumées et de la chaleur -
Partie 7: Tronçons de conduit de désenfumage

Rauch- und Wärmefreihaltung - Teil 7:
Entrauchungsleitungen

This European Standard was approved by CEN on 17 March 2011.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	4
Introduction	5
1 Scope	8
2 Normative references	8
3 Terms and definitions	8
4 Smoke control duct section requirements.....	10
4.1 General.....	10
4.1.1 Fire resistance - multi compartment smoke control duct section.....	10
4.1.2 Fire resistance - single compartment smoke control duct section.....	11
4.2 Construction and components: characteristics.....	11
4.2.1 Construction and operation.....	11
4.2.2 Structural supports used for smoke control duct sections	11
4.3 Fire resistance performance criteria: Multi compartment fire resisting smoke control duct sections	12
4.3.1 Integrity, insulation, leakage,	12
4.3.2 Fire resistance classification and designation.....	13
4.4 Fire resistance performance criteria: Single compartment smoke control duct sections	13
4.4.1 Integrity, leakage.....	13
4.4.2 Fire resistance classification and designation.....	13
5 Test methods.....	14
5.1 Ambient leakage tests	14
5.2 Fire resistance tests	14
5.2.1 General.....	14
5.2.2 Smoke control duct section: integrity and insulation.....	14
5.2.3 Leakage rated smoke control duct section.....	15
6 Evaluation of conformity.....	15
6.1 General.....	15
6.2 Initial type testing (ITT)	15
6.2.1 General.....	15
6.2.2 Modifications.....	15
6.2.3 Previous tests and product families	16
6.2.4 Test samples	16
6.2.5 Test report	16
6.3 Factory product control (FPC).....	17
6.3.1 General.....	17
6.3.2 General requirements.....	17
6.3.3 FPC specific requirements	17
6.3.4 Initial inspection of factory and FPC	19
6.3.5 Continuous surveillance of FPC	20
6.3.6 Procedure for modifications.....	20
6.4 One-off smoke control duct sections, pre-production smoke control duct sections (e.g. prototypes) and smoke control duct sections produced in very low quantities	20
7 Marking and documentation.....	21
8 Product, installation and maintenance information (documentation)	21
8.1 Product specification	21
8.2 Installation information	21
8.3 Maintenance information	22

Annex A (informative) Example of inspection and maintenance procedure	23
Annex B (normative) Factory production control – test plan	24
Annex ZA (informative) Clauses of this European Standard addressing the provisions of the EU Construction Products Directive	25
ZA.1 Scope and relevant characteristics	25
ZA.2 Procedure for the attestation of conformity of smoke control duct sections	27
ZA.2.2 EC certificate of conformity and EC declaration of conformity	28
ZA.3 CE Marking	29
Bibliography	30

This document is a preview generated by EVS

Foreword

This document (EN 12101-7:2011) has been prepared by Technical Committee CEN/TC 191 “Fixed firefighting systems”, the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by November 2011, and conflicting national standards shall be withdrawn at the latest by November 2011.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For relationship with EU Directive(s), see informative Annex ZA, which is an integral part of this document.

This European Standard has the general title “*Smoke and heat control systems*” and consists of the following separate Parts:

Part 1: Specification for smoke barriers,

Part 2: Specification for natural smoke and heat exhaust ventilators,

Part 3: Specification for powered smoke and heat exhaust ventilators,

Part 4: Installed SHEVS systems for smoke and heat ventilation (Technical Report (TR)),

Part 5: Guidelines on functional recommendations and calculation methods for smoke and heat exhaust ventilation systems (TR),

Part 6: Specification for pressure differential systems – Kits,

Part 7: Smoke duct sections (this standard),

Part 8: Smoke control dampers,

Part 9: Control panels,

Part 10: Power supplies.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

Introduction

This European Standard contains the basic performance and requirements for smoke control duct sections, which are to be used in conjunction with pressure differential systems and smoke and heat control systems. They may also be used to pressurise when gas extinguishing systems are used.

Particular reference is required to EN 1366-8 and EN 1366-9, which define the fire resistance testing associated with these products and EN 13501-4, which provides details on their fire resistance classification.


In addition to the prevention of transmission of smoke and combustion products from a fire zone, smoke control duct sections are utilised to contain the spillage of otherwise harmful and toxic extinguishing gases from the affected area, and for the control of pressurising and excess air relief within pressurisation systems.

Smoke control systems are designed to fulfil three basic functions. These are:

- a) the extraction of smoke from a single fire compartment to the outside of the building;
- b) the extraction of smoke from fire compartments of a building, using a SHEVS connected to one or more fire compartments. The smoke control duct may or may not pass through other compartments of the building to reach the outside of the building;
- c) the use of pressurisation to maintain smoke free clear areas.

Smoke control ducts are commonly used in smoke and heat control systems. They may serve single compartments or a number of different fire compartments. The systems may be dedicated smoke extraction or possibly a combined environmental ventilation/smoke extraction.

The smoke and heat control system may remove smoke using either high temperature fans (in accordance with EN 12101-3) or natural ventilators (in accordance with EN 12101-2).

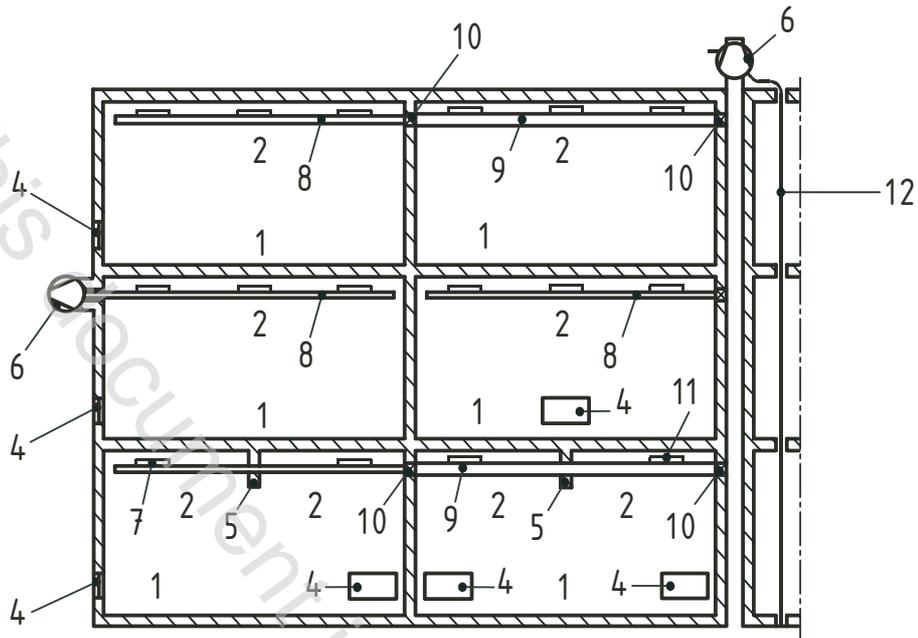

Key

- 1 Fire compartment
- 2 Smoke reservoir
- 4 Air inlet
- 5 Smoke barrier
- 6 Powered smoke and heat exhaust ventilator (fan)
- 7 Smoke control dampers for single compartments (FprEN 12101-8 and prEN 1366-10)
- 8 Smoke control duct sections for single compartments (FprEN 12101-7 and EN 1366-9)
- 9 Smoke control duct sections for multi compartments (FprEN 12101-7 and EN 1366-8)
- 10 Smoke control dampers for multi compartments (FprEN 12101-8 and prEN 1366-10) mounted inside or outside of wall or floor
- 11 Smoke control dampers for multi compartments (FprEN 12101-8 and prEN 1366-10) mounted on the surface of the duct
- 12 Electrical equipment

Figure 1 – Example of powered smoke and heat exhaust ventilation

Further guidance on the application of smoke control ducts may be found within the rest of the EN 12101 series of harmonised standards and technical reports.

The areas for which products supplied to this European Standard are considered applicable include for example:

- a) commercial premises,
- b) shopping and retail centres,
- c) hospitals,
- d) multi-residential buildings.

Smoke control duct sections are intended for use in the following types of systems, including:

- a) pressurisation,

- b) pressure relief,
- c) extraction systems,
- d) ductwork systems,
- e) inerting fire suppression systems.

It is realised that all the above systems do not address smoke directly, but similar properties are required of such smoke control ducts to limit leakage in a fire and smoke control situation.

This document is a preview generated by EVS

1 Scope

This European Standard applies to smoke control duct sections, placed on the market and intended to operate as part of a pressure differential system or smoke and heat exhaust system. This standard specifies requirements and gives reference to the test methods defined for smoke control duct sections and their associated components (for example, hangers and other items proven at the time of testing), which are intended to be installed in such systems in buildings. It also provides for the evaluation of conformity of the products to the requirements of this standard. Furthermore, marking and information on installation and maintenance of these products are also given in this European Standard.

To avoid duplication, reference is made to a variety of other standards. To this end, this standard is to be read in conjunction with EN 1366-8, EN 1366-9 and EN 1366-1, for details of the fire resistance testing and EN 13501-4 for corresponding classification.

This standard has not considered in detail the detrimental and/or corrosive effects that may be caused by process chemicals present in the atmosphere, which are drawn through the system intentionally or inadvertently.

This European Standard also governs associated components used together with smoke control duct sections such as turning vanes and silencers, with the exception of natural and powered smoke ventilators and smoke control dampers, which are covered by separate standards.

Ducts for use other than in smoke and heat exhaust/control systems are not covered by this standard.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies).

EN 1366-1, *Fire resistance tests for service installations – Part 1: Ducts*

EN 1366-8, *Fire resistance tests for service installations – Part 8: Smoke extraction ducts*

EN 1366-9, *Fire resistance tests for service installations – Part 9: Single compartment smoke extraction ducts*

EN 13501-4, *Fire classification of construction products and building elements – Part 4: Classification using data from fire resistance tests on components of smoke control systems*

EN ISO 13943, *Fire safety – Vocabulary (ISO 13943:2008)*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN ISO 13943, together with the following apply.

3.1

air inlet

device connected to outside air to allow the inlet of air from outside the construction works

3.2

elevated temperature

temperatures in excess of normal ambient air, below those necessary for fire resistance testing, to which smoke and heat exhaust ducts for single compartments are tested