

Plastics piping systems for renovation of underground drainage and sewerage networks under pressure - Part 3: Lining with close-fit pipes (ISO 11297-3:2018)

EESTI STANDARDI EESSÕNA

NATIONAL FOREWORD

| | |
|---------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------|
| See Eesti standard EVS-EN ISO 11297-3:2018 sisaldab Euroopa standardi EN ISO 11297-3:2018 ingliskeelset teksti. | This Estonian standard EVS-EN ISO 11297-3:2018 consists of the English text of the European standard EN ISO 11297-3:2018. |
| Standard on jõustunud sellekohase teate avaldamisega EVS Teatajas | This standard has been endorsed with a notification published in the official bulletin of the Estonian Centre for Standardisation. |
| Euroopa standardimisorganisatsioonid on teinud Euroopa standardi rahvuslikele liikmetele kättesaadavaks 10.10.2018. | Date of Availability of the European standard is 10.10.2018. |
| Standard on kättesaadav Eesti Standardikeskusest. | The standard is available from the Estonian Centre for Standardisation. |

Tagasisidet standardi sisu kohta on võimalik edastada, kasutades EVS-i veebilehel asuvat tagasiside vormi või saates e-kirja meiliaadressile standardiosakond@evs.ee.

ICS 23.040.20, 23.040.45, 91.140.80, 93.030

Standardite reprodutseerimise ja levitamise õigus kuulub Eesti Standardikeskusele

Andmete paljundamine, taastekitamine, kopeerimine, salvestamine elektroonsesse süsteemi või edastamine ükskõik millises vormis või millisel teel ilma Eesti Standardikeskuse kirjaliku loata on keelatud.

Kui Teil on küsimusi standardite autorikaitse kohta, võtke palun ühendust Eesti Standardikeskusega:
Koduleht www.evs.ee; telefon 605 5050; e-post info@evs.ee

The right to reproduce and distribute standards belongs to the Estonian Centre for Standardisation

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying, without a written permission from the Estonian Centre for Standardisation.

If you have any questions about copyright, please contact Estonian Centre for Standardisation:

Homepage www.evs.ee; phone +372 605 5050; e-mail info@evs.ee

EUROPEAN STANDARD

EN ISO 11297-3

NORME EUROPÉENNE

EUROPÄISCHE NORM

October 2018

ICS 23.040.20; 23.040.45; 91.140.80; 93.030

Supersedes EN ISO 11297-3:2013

English Version

**Plastics piping systems for renovation of underground
drainage and sewerage networks under pressure - Part 3:
Lining with close-fit pipes (ISO 11297-3:2018)**

Systèmes de canalisations en plastique pour la
rénovation des réseaux de branchements et de
collecteurs d'assainissement enterrés sous pression -
Partie 3: Tubage par tuyau continu sans espace
annulaire (ISO 11297-3:2018)

Kunststoff-Rohrleitungssysteme für die Renovierung
von erdverlegten Abwasserdruckleitungen - Teil 3:
Close-Fit-Lining (ISO 11297-3:2018)

This European Standard was approved by CEN on 26 August 2018.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

European foreword

This document (EN ISO 11297-3:2018) has been prepared by Technical Committee ISO/TC 138 "Plastics pipes, fittings and valves for the transport of fluids" in collaboration with Technical Committee CEN/TC 155 "Plastics piping systems and ducting systems" the secretariat of which is held by NEN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by April 2019, and conflicting national standards shall be withdrawn at the latest by April 2019.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN ISO 11297-3:2013.

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Endorsement notice

The text of ISO 11297-3:2018 has been approved by CEN as EN ISO 11297-3:2018 without any modification.

Contents

| | Page |
|------------------------------------------------------------------------------------|-----------|
| Foreword | v |
| Introduction | vi |
| 1 Scope | 1 |
| 2 Normative references | 1 |
| 3 Terms and definitions | 2 |
| 3.1 General..... | 2 |
| 3.2 Techniques..... | 3 |
| 3.3 Characteristics..... | 3 |
| 3.4 Materials..... | 3 |
| 3.5 Product stages..... | 3 |
| 3.6 Service conditions..... | 3 |
| 3.7 Joints..... | 4 |
| 4 Symbols and abbreviated terms | 4 |
| 4.1 Symbols..... | 4 |
| 4.2 Abbreviated terms..... | 5 |
| 5 Pipes at the “M” stage | 5 |
| 5.1 Materials..... | 5 |
| 5.1.1 Virgin material..... | 5 |
| 5.1.2 Reprocessable and recyclable material..... | 5 |
| 5.2 General characteristics..... | 5 |
| 5.2.1 Appearance..... | 5 |
| 5.2.2 Colour..... | 5 |
| 5.3 Material characteristics..... | 6 |
| 5.4 Geometric characteristics..... | 6 |
| 5.5 Mechanical characteristics..... | 6 |
| 5.6 Physical characteristics..... | 6 |
| 5.7 Jointing..... | 6 |
| 5.8 Marking..... | 6 |
| 5.9 Regional requirements for pipes..... | 7 |
| 6 Fittings at the “M” stage | 7 |
| 6.1 Requirements..... | 7 |
| 6.2 Marking..... | 7 |
| 6.3 Regional requirements for fittings..... | 7 |
| 7 Ancillary components | 7 |
| 8 Fitness for purpose of the installed lining system at the “I” stage | 7 |
| 8.1 Materials..... | 7 |
| 8.2 General characteristics..... | 7 |
| 8.3 Material characteristics..... | 7 |
| 8.4 Geometric characteristics..... | 8 |
| 8.5 Mechanical characteristics..... | 8 |
| 8.6 Physical characteristics..... | 9 |
| 8.7 Additional characteristics..... | 9 |
| 8.8 Sampling..... | 10 |
| 8.9 Regional requirements for the installed lining system..... | 10 |
| 9 Installation practice | 10 |
| 9.1 Preparatory work..... | 10 |
| 9.2 Storage, handling and transport of pipes and fittings..... | 10 |
| 9.3 Equipment..... | 10 |
| 9.3.1 Butt fusion and debanding equipment..... | 10 |
| 9.3.2 Reduction equipment..... | 11 |
| 9.3.3 Pipe skids/rollers..... | 11 |

| | | |
|---------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------|-----------|
| 9.3.4 | Winching and rod-pulling equipment..... | 11 |
| 9.3.5 | Pipe entry guides..... | 11 |
| 9.3.6 | Reforming equipment..... | 11 |
| 9.3.7 | Electrofusion equipment..... | 12 |
| 9.3.8 | Inspection equipment..... | 12 |
| 9.3.9 | Lifting equipment..... | 12 |
| 9.4 | Installation..... | 12 |
| 9.5 | Process-related inspection and testing..... | 13 |
| 9.6 | Lining termination..... | 13 |
| 9.7 | Reconnection to existing manholes and laterals..... | 13 |
| 9.8 | Final inspection and testing..... | 13 |
| 9.9 | Documentation..... | 13 |
| Annex A (normative) Factory-folded heat-reverted polyethylene (PE) pipe — Determination of memory ability..... | | 14 |
| Bibliography..... | | 16 |

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see the following URL: www.iso.org/iso/foreword.html.

This document was prepared by ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 8, *Rehabilitation of pipeline systems*.

This second edition cancels and replaces the first edition (ISO 11297-3:2013), which has been technically revised.

The main changes compared to the previous edition are as follows:

- [Figure 1](#) and [Clauses 1, 5.2.2, 5.5, 8.4, 9.3.4](#) and [9.4](#) have been technically revised;
- New sub-clauses [5.9](#), [6.3](#) and [8.9](#) specifying regional requirements for pipes, fittings and the installed system respectively, have also been added in accordance with the Vienna Agreement, to allow reference to European standards in countries where these are mandated by law in place of ISO standards of identical scope.

A list of all parts in the ISO 11297 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

This International Standard is a part of a system standard for plastics piping systems of various materials used for renovation of existing pipelines in a specified application area. System standards for renovation dealing with the following applications are either available or in preparation:

- ISO 11296, *Plastics piping systems for renovation of underground non-pressure drainage and sewerage networks*;
- ISO 11297, *Plastics piping systems for renovation of underground drainage and sewerage networks under pressure* (this document);
- ISO 11298, *Plastics piping systems for renovation of underground water supply networks*;
- ISO 11299, *Plastics piping systems for renovation of underground gas supply networks*.

These system standards are distinguished from system standards for conventionally installed plastics piping systems by the requirement to verify certain characteristics in the “as installed” condition, after site processing. This is in addition to verification of characteristics of plastics piping systems “as manufactured”.

Each of the System Standards comprises a:

- *Part 1: General*

and all applicable renovation technique family-related parts, which for non- drainage and sewerage networks under pressure include or potentially include the following:

- *Part 2: Lining with continuous pipes*
- *Part 3: Lining with close-fit pipes* (this document)
- *Part 4: Lining with cured-in-place pipes*
- *Part 5: Lining with discrete pipes*
- *Part 6: Lining with adhesive-backed hoses*

The requirements for any given renovation technique family are specified in Part 1, applied in conjunction with the relevant other part. For example, both ISO 11297-1 and this document together specify the requirements relating to lining with close-fit pipes. For complementary information, see ISO 11295. Not all technique families are pertinent to every area of application and this is reflected in the part numbers included in each System Standard.

A consistent structure of clause headings has been adopted for all parts to facilitate direct comparisons across renovation technique families.

[Figure 1](#) shows the common part and clause structure and the relationship between ISO 11297 and system standards for other applications.

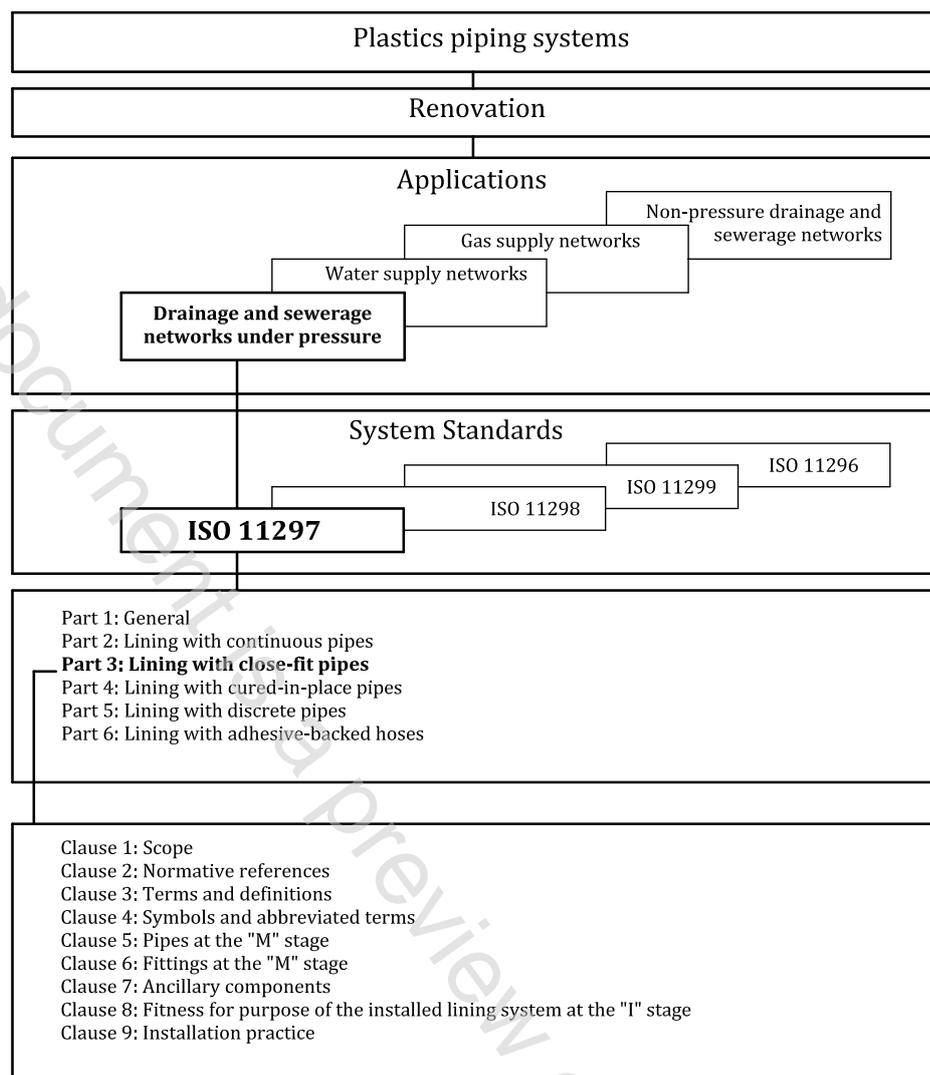


Figure 1 — Format of the renovation system standards

Plastics piping systems for renovation of underground drainage and sewerage networks under pressure —

Part 3: Lining with close-fit pipes

1 Scope

This document, in conjunction with ISO 11297-1, specifies requirements and test methods for close-fit lining systems intended to be used for the renovation of underground drainage and sewerage networks under pressure.

It applies to pipes and fittings, as manufactured, as well as to the installed lining system. It is applicable to polyethylene (PE) pipes of either solid wall single layer or co-extruded layer construction, which is reduced in the factory or on site to provide a close-fitting independent or interactive pressure pipe liner, as well as associated fittings and joints for the construction of the lining system. It is not applicable to PE coated pipes having a peelable, contiguous, thermoplastic additional layer on the outside of the pipe.

It is applicable to PE pipes, fittings and assemblies intended to be used at an operating temperature of 20 °C as the reference temperature.

NOTE For applications operating at constant temperatures greater than 20 °C and up to 40 °C, see ISO 4427-1:2007, Annex A.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 3, *Preferred numbers — Series of preferred numbers*

ISO 3126, *Plastics piping systems — Plastics components — Determination of dimensions*

ISO 4427-1:2007, *Plastics piping systems — Polyethylene (PE) pipes and fittings for water supply — Part 1: General*

ISO 4427-2:2007, *Plastics piping systems — Polyethylene (PE) pipes and fittings for water supply — Part 2: Pipes*

ISO 4427-3, *Plastics piping systems — Polyethylene (PE) pipes and fittings for water supply — Part 3: Fittings*

ISO 4427-5:2007, *Plastics piping systems — Polyethylene (PE) pipes and fittings for water supply — Part 5: Fitness for purpose of the system*

ISO 8772, *Plastics piping systems for non-pressure underground drainage and sewerage — Polyethylene (PE)*

ISO 9967, *Thermoplastics pipes — Determination of creep ratio*

ISO 11297-1:2018, *Plastics piping systems for renovation of underground drainage and sewerage networks under pressure — Part 1: General*

ISO 12176-1, *Plastics pipes and fittings — Equipment for fusion jointing polyethylene systems — Part 1: Butt fusion*

ISO 12176-2, *Plastics pipes and fittings — Equipment for fusion jointing polyethylene systems — Part 2: Electrofusion*

EN 12201-1, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 1: General*

EN 12201-2:2011, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 2: Pipes*

EN 12201-3, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 3: Fittings*

EN 12201-4, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 4: Valves for water supply systems*

EN 12201-5, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

EN 12666-1, *Plastics piping systems for non-pressure underground drainage and sewerage — Polyethylene (PE) — Part 1: Specifications for pipes, fittings and the system*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 11297-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

3.1 General

3.1.1

compound formulation

clearly defined homogenous mixture of base polymer with additives, e.g. antioxidants, pigments, stabilizers and others, at a dosage level necessary for the processing and intended use of the final product

3.1.2

solid wall single layered pipe

pipe with smooth internal and external surface, extruded from the same *compound formulation* (3.1.1) throughout the wall

3.1.3

pipe with co-extruded layers

pipe with smooth internal and external surface, having co-extruded layers on either or both the outside and inside of the pipe, where all layers have the same MRS rating

3.1.4

close fit

situation of the outside of the installed liner relative to the inside of the existing pipeline, which may either be an interference fit or include a small annular gap resulting from shrinkage and tolerances only

3.1.5

close-fit pipe

continuous lining pipe of thermoplastic material reshaped or otherwise expanded after insertion to achieve a close fit to the existing pipeline